

electrical documentation  
Elektrodokumentation




type Gerätetyp	rated voltage Bemessungsspannung	frequency Frequenz	rated power Bemessungsaufnahme	rated current Bemessungsstrom
C4e 12.20 EB	3~400V	50/60Hz	33,7kW	48,7A
C4e 12.20 EB	3~440V	50/60Hz	28,2kW	37,0A
C4e 12.20 EB	3~480V	50/60Hz	33,4kW	40,3A

Welbilt Deutschland GmbH


Talstraße 35  
D-82436 Eglfing / Germany  
  
+49 (0)8847 - 67 - 0  
  
+49 (0)8847 - 67 - 414  
  
www.convotherm.com


fuses on site!  
Please look at local supply regulations!  
Absicherung bauseits!  
Örtliche EVU-Vorschriften beachten!

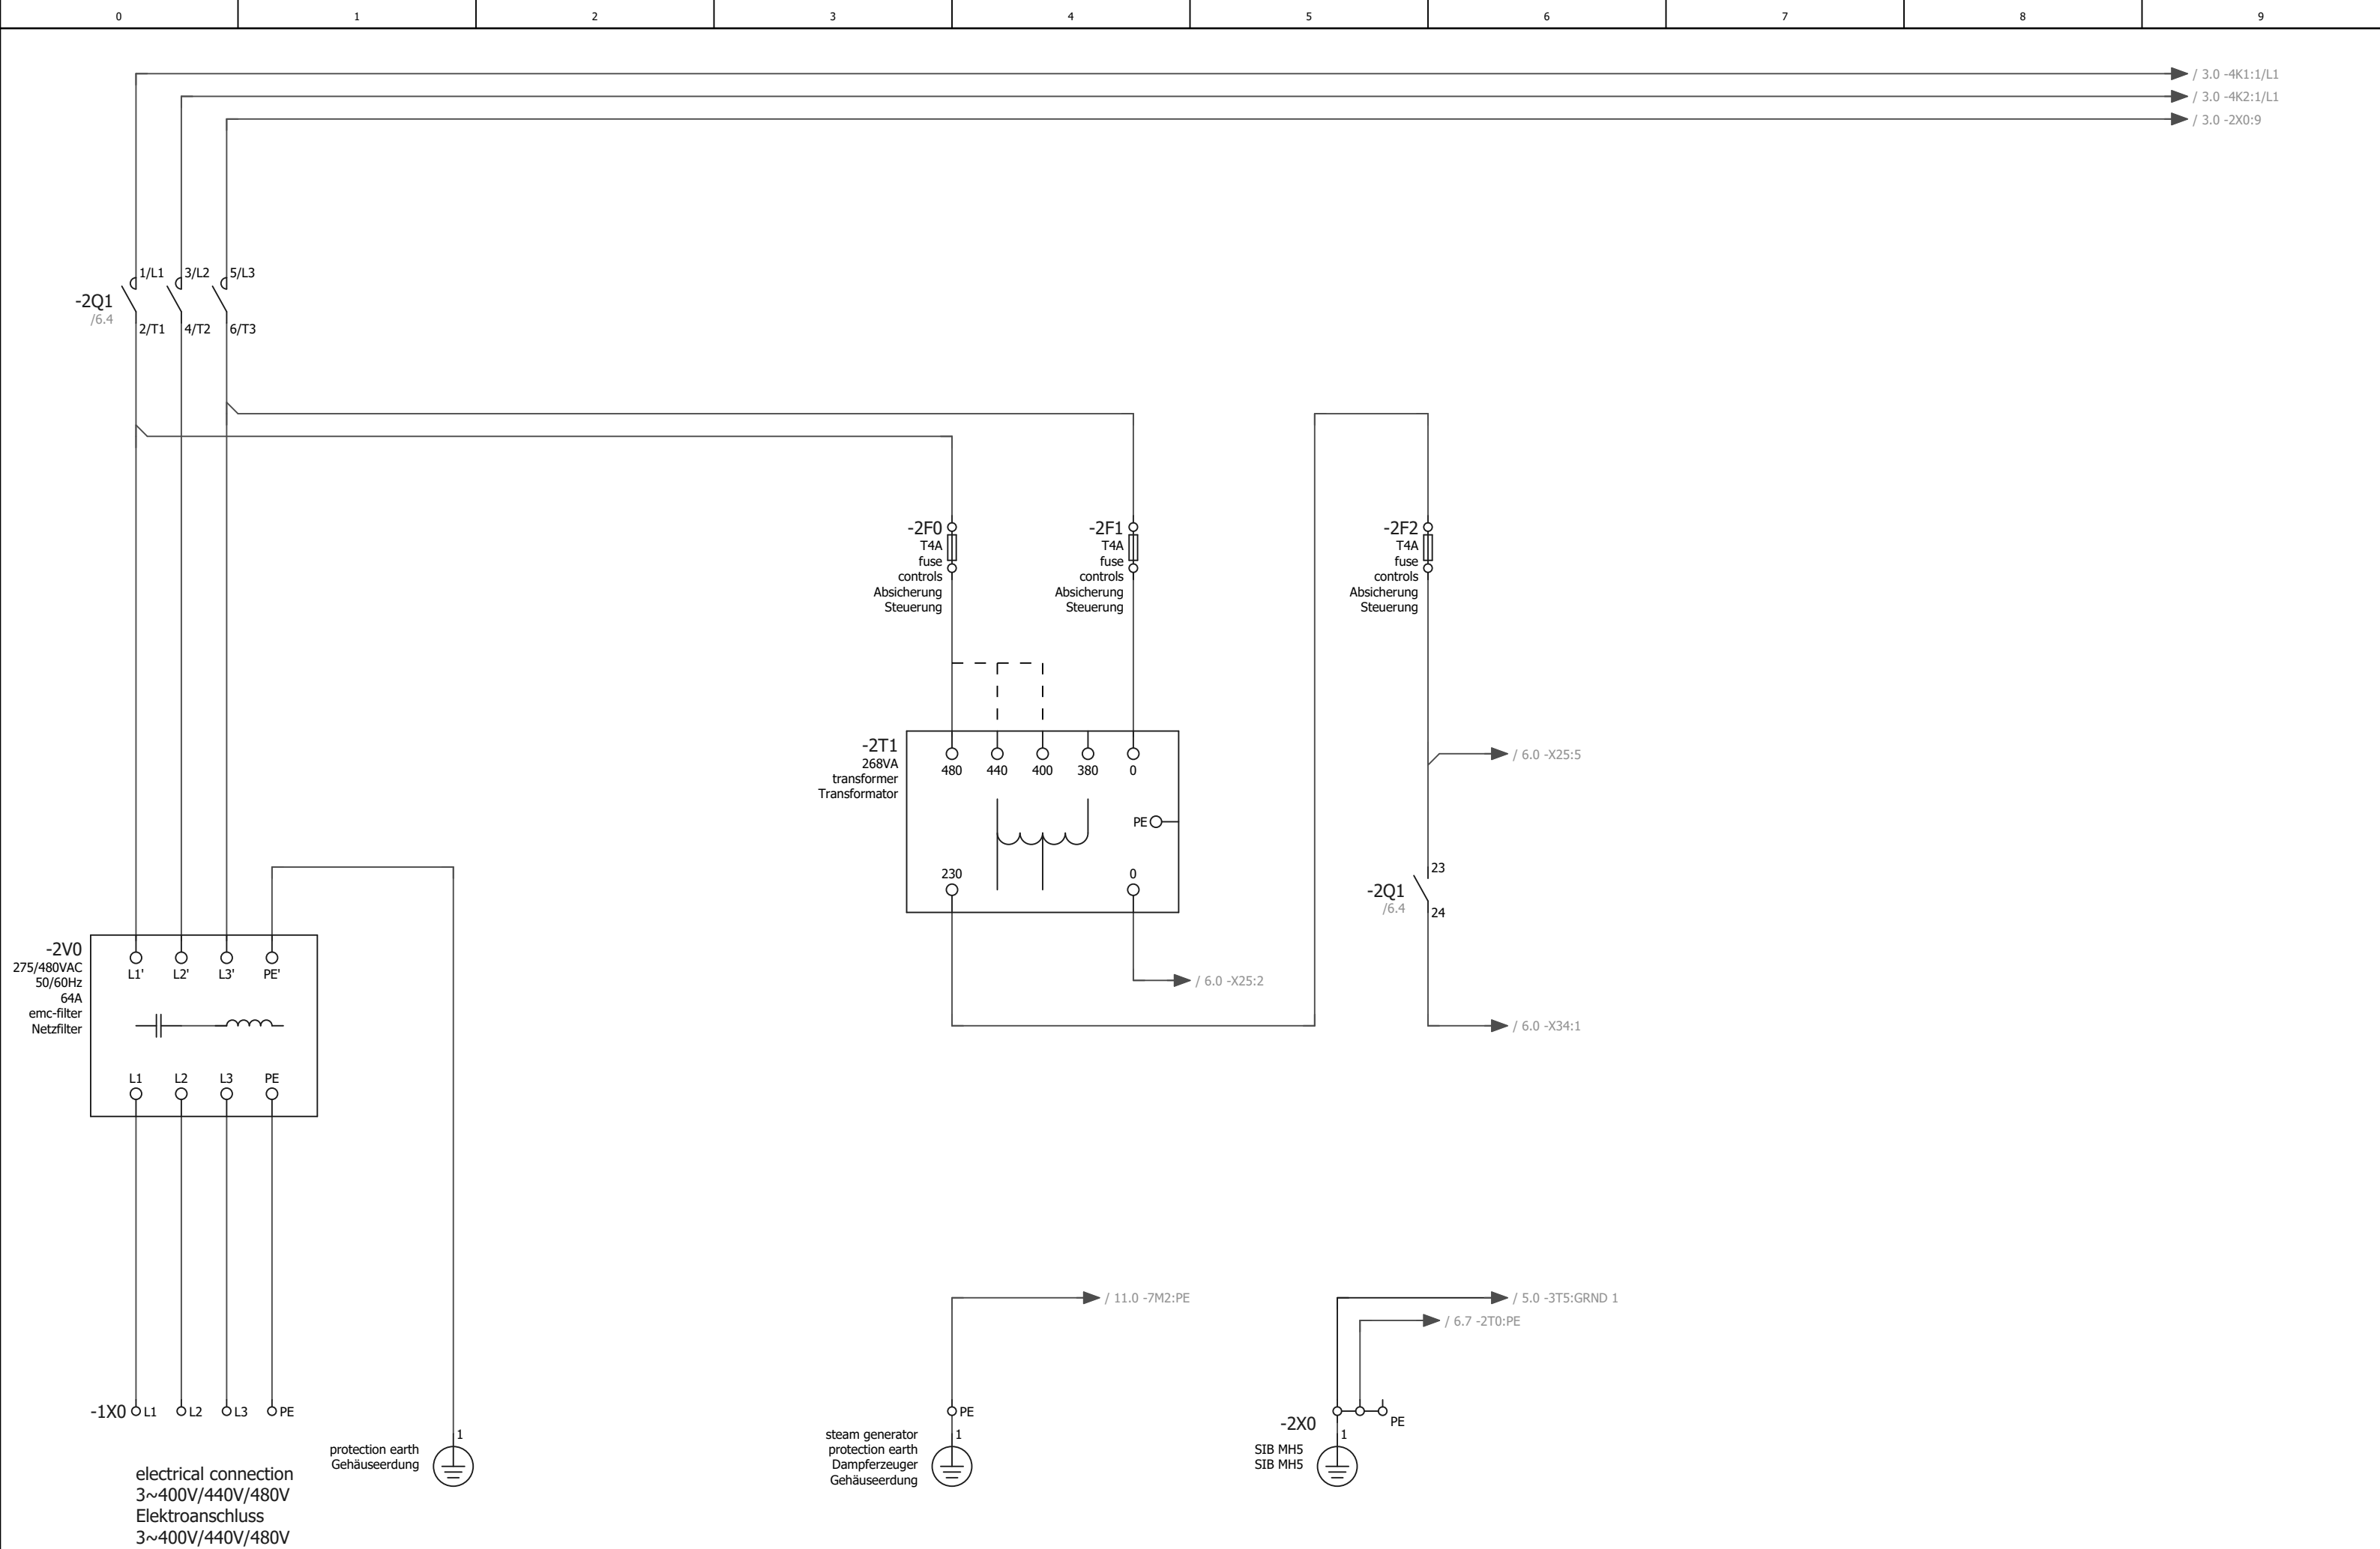


1						3						
03	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 12.20 EB C4e 12.20 EB C4e 12.20 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	supply Einspeisung	Project No.		= SLP	
02	ÄM071/2015	09.04.2015	SchM	Name	Boe				5354158		+ MPL	
01	ÄM107/2014	22.10.2014	SchM	App.	SchM				Drg. No.		Blatt 2	
REV	Remarks	Date	Name	Norm					5153102		Seite 2 / 12	


03	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 12.20 EB C4e 12.20 EB C4e 12.20 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	convection Heissluft	Project No. 5354158		= SLP	
02	ÄM071/2015	09.04.2015	SchM	Name	Boe				+ MPL			
01	ÄM107/2014	22.10.2014	SchM	App.	SchM				Drg. No. 5153102		Blatt	3
REV	Remarks	Date	Name	Norm							Seite	3 / 12




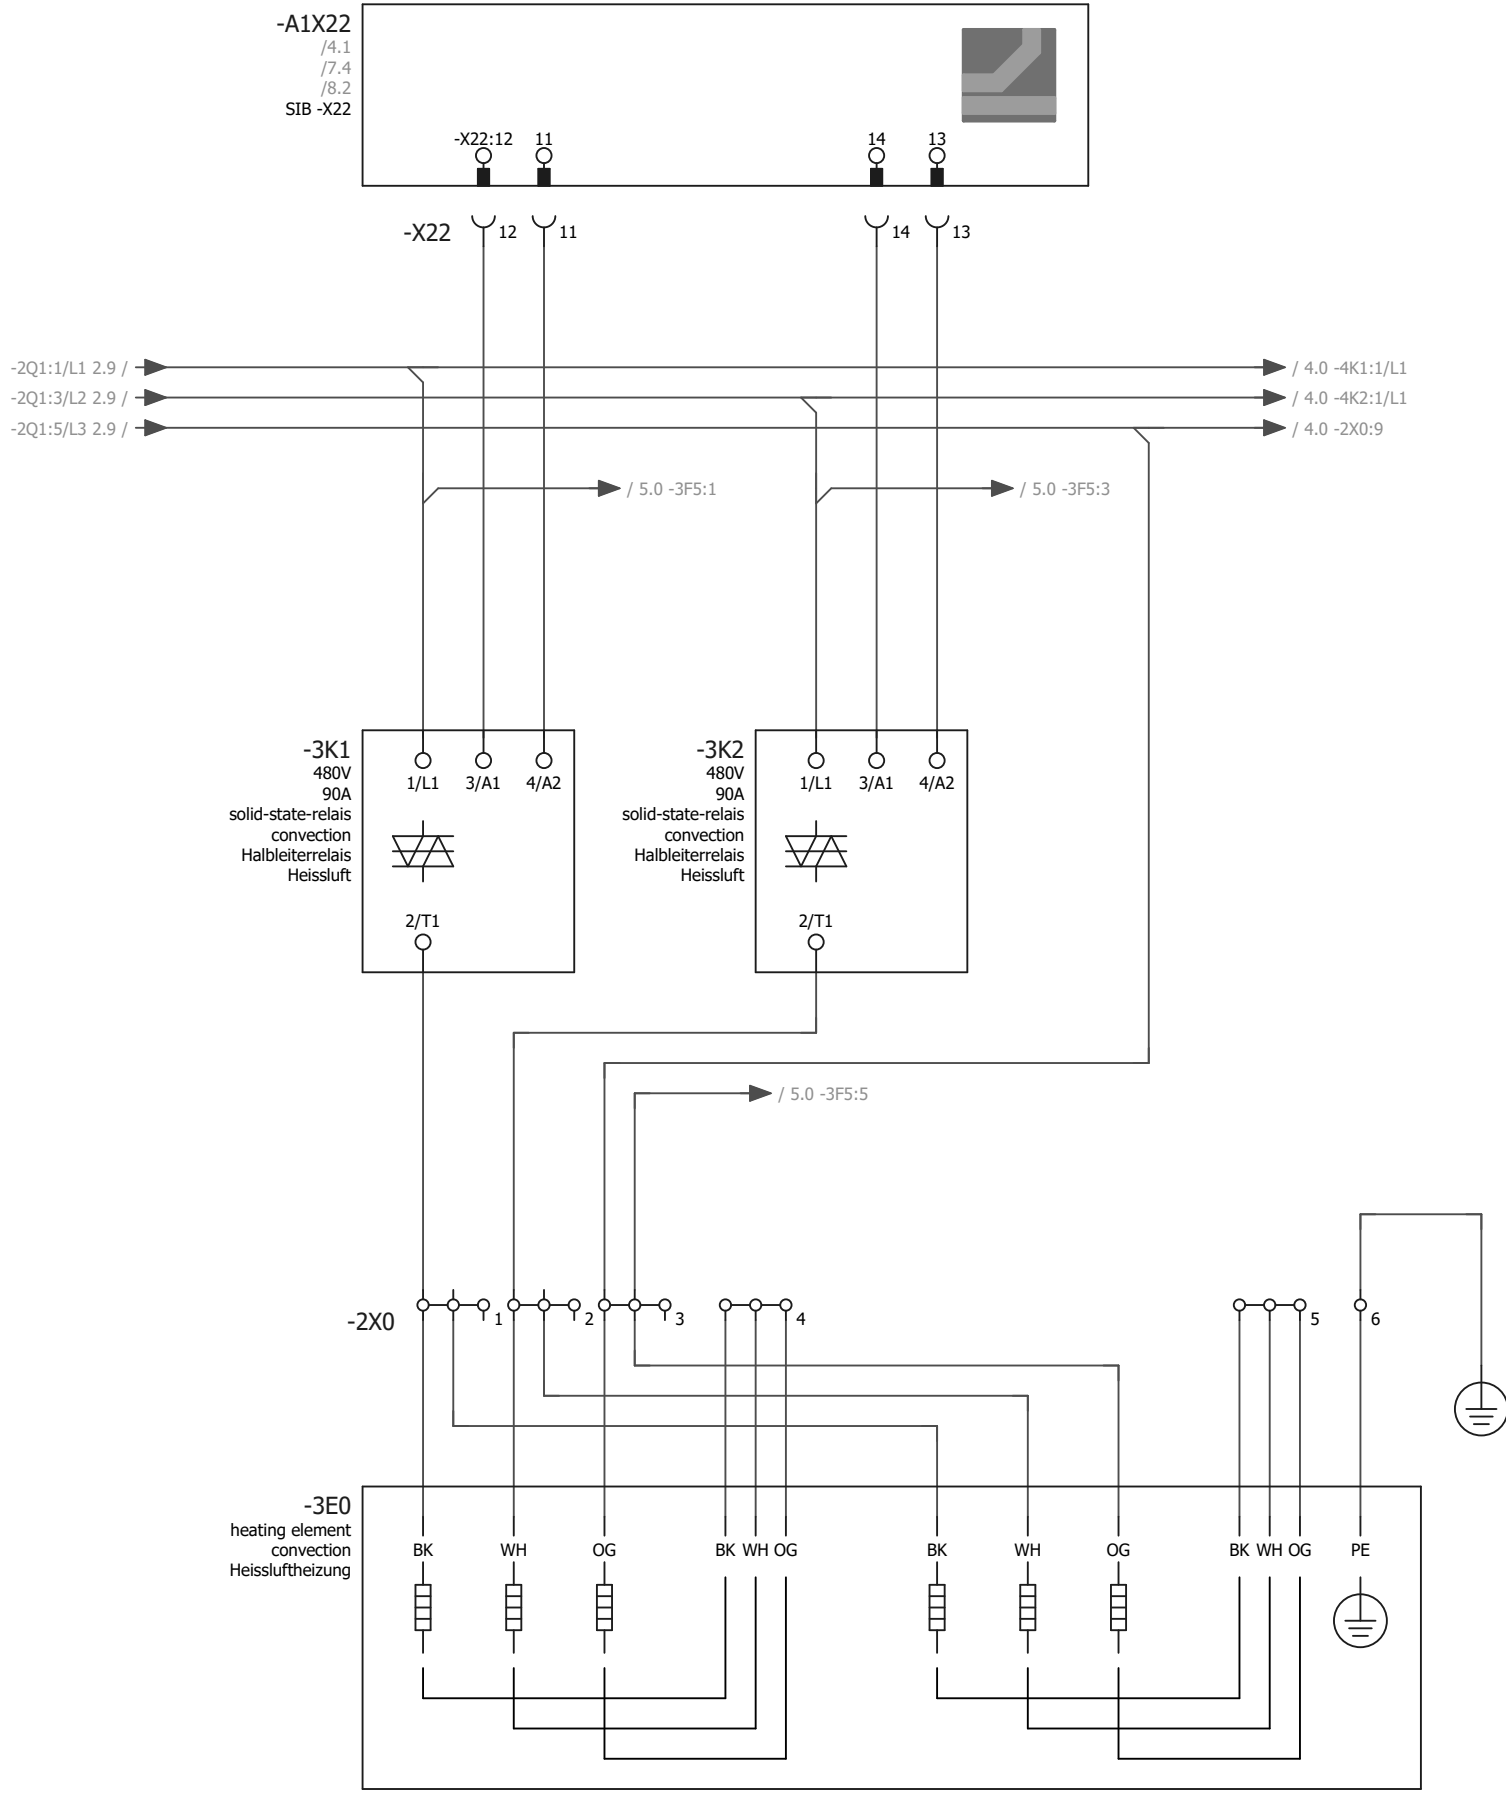


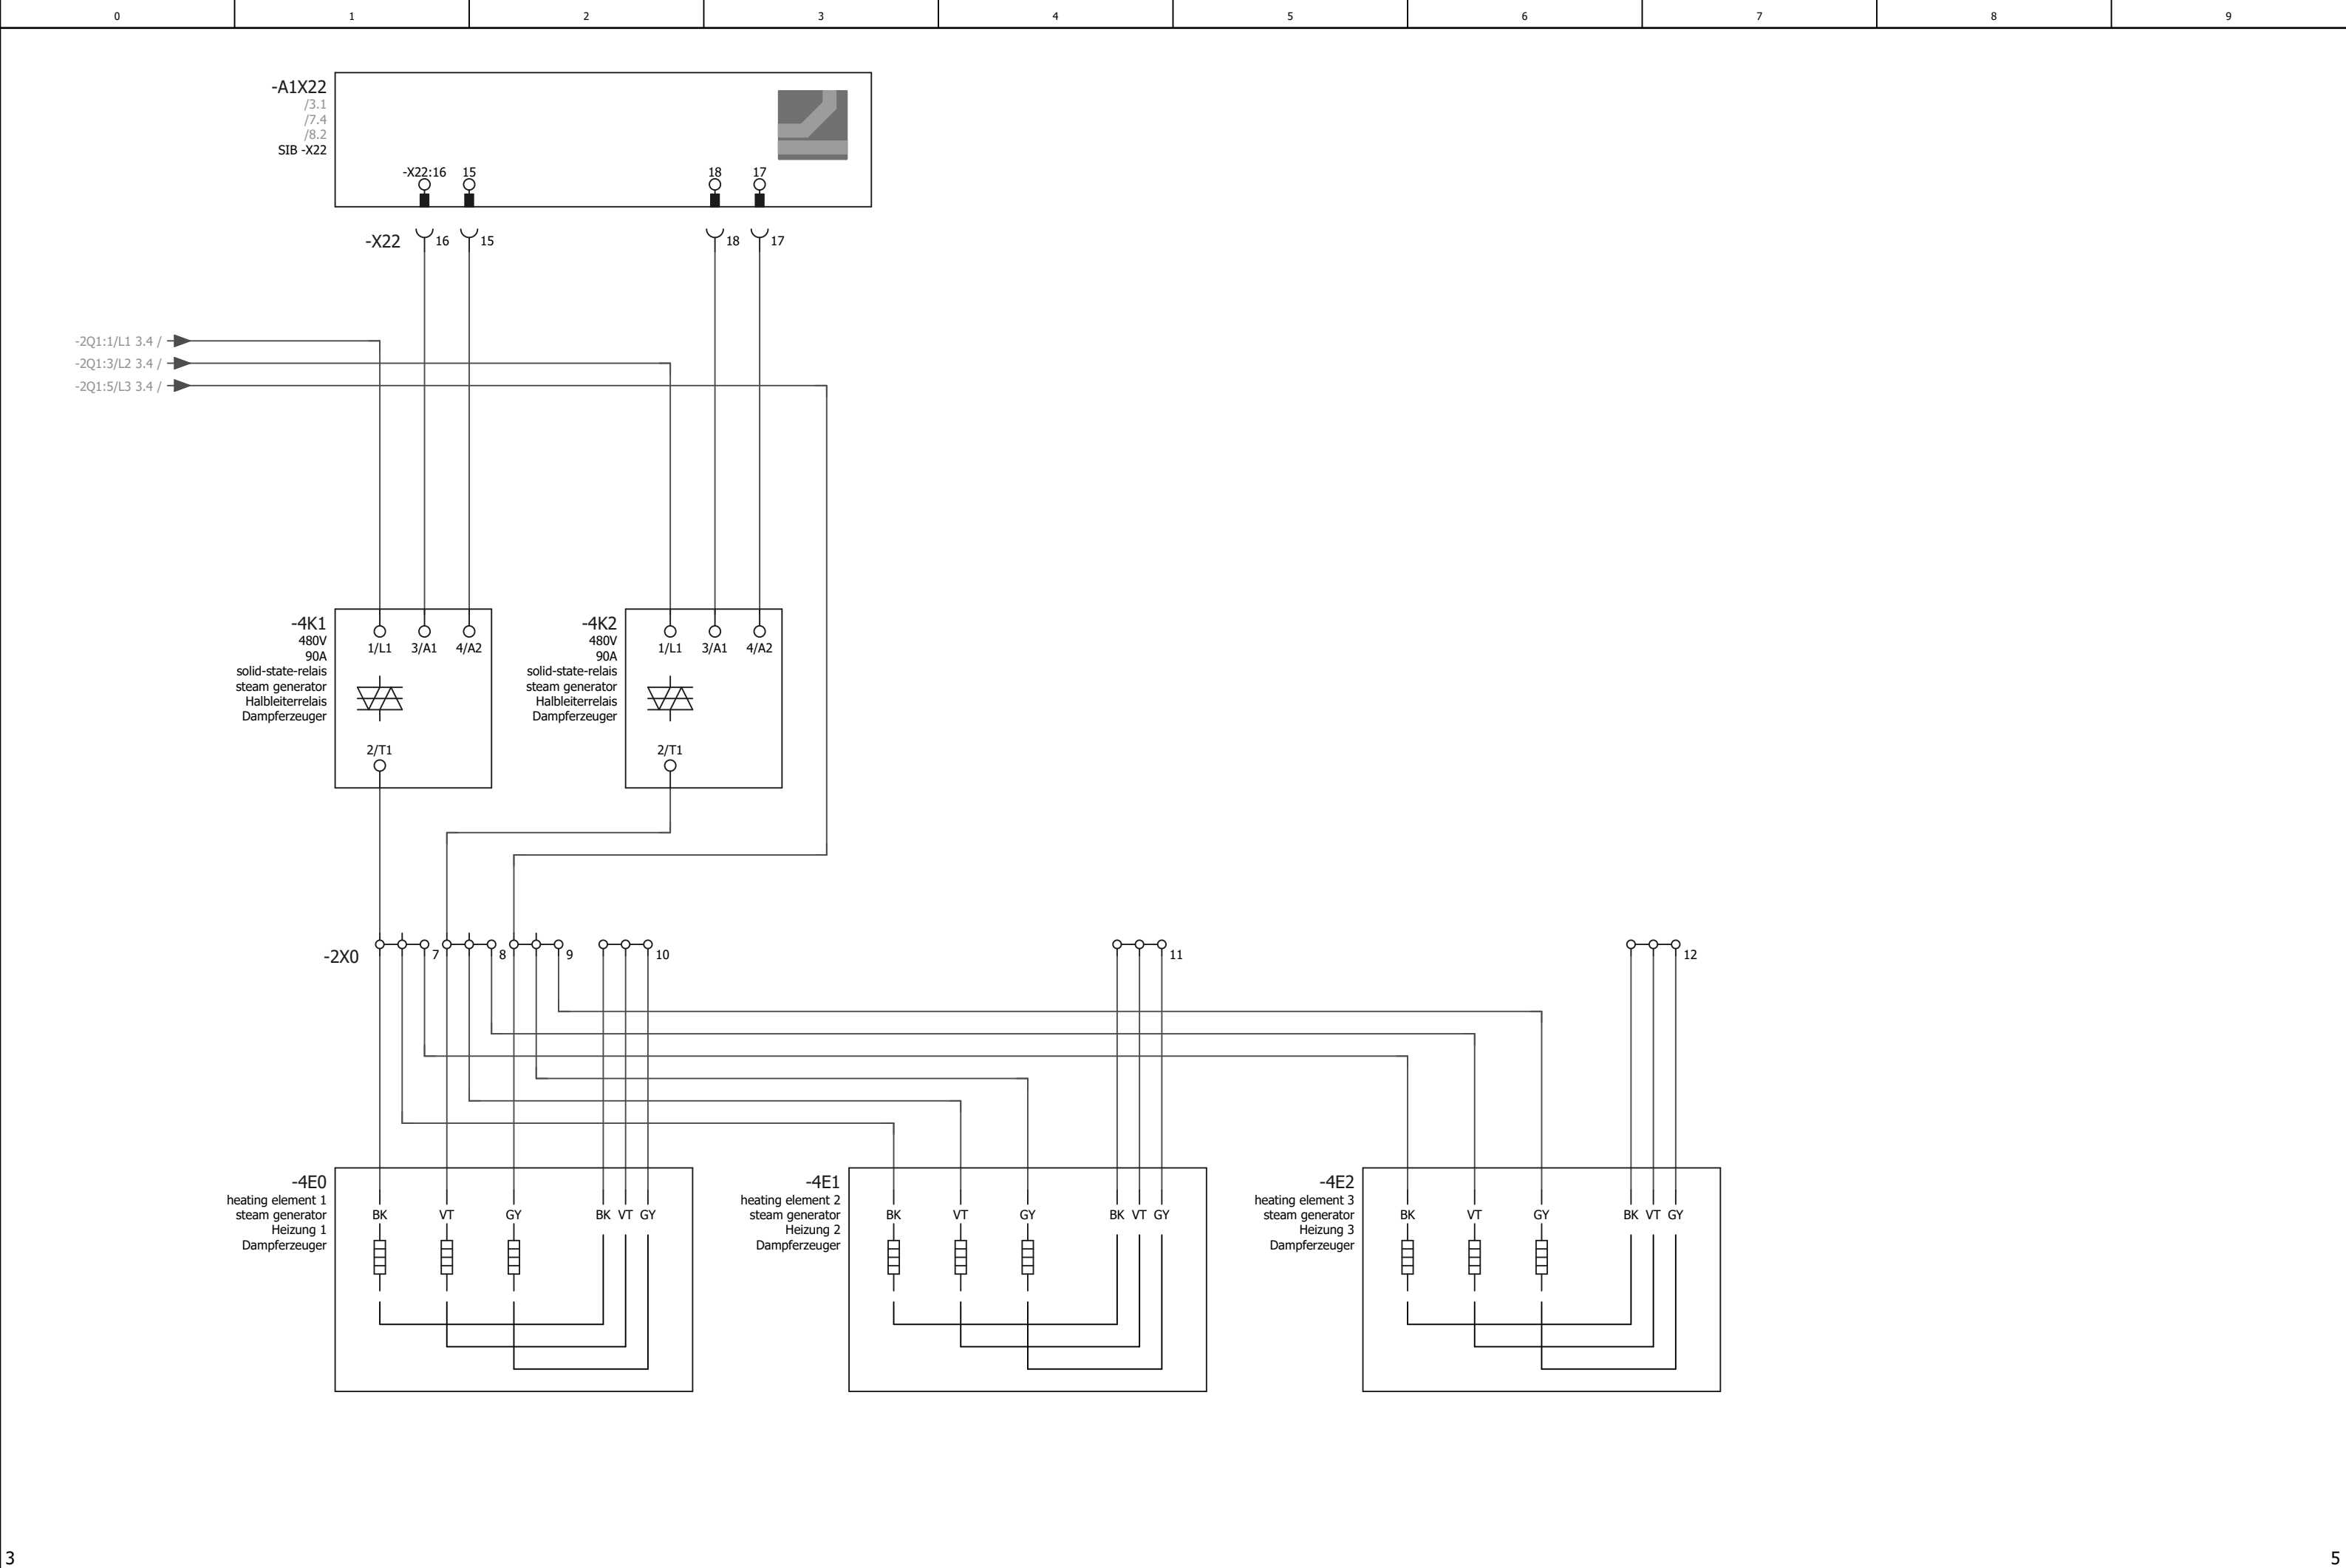

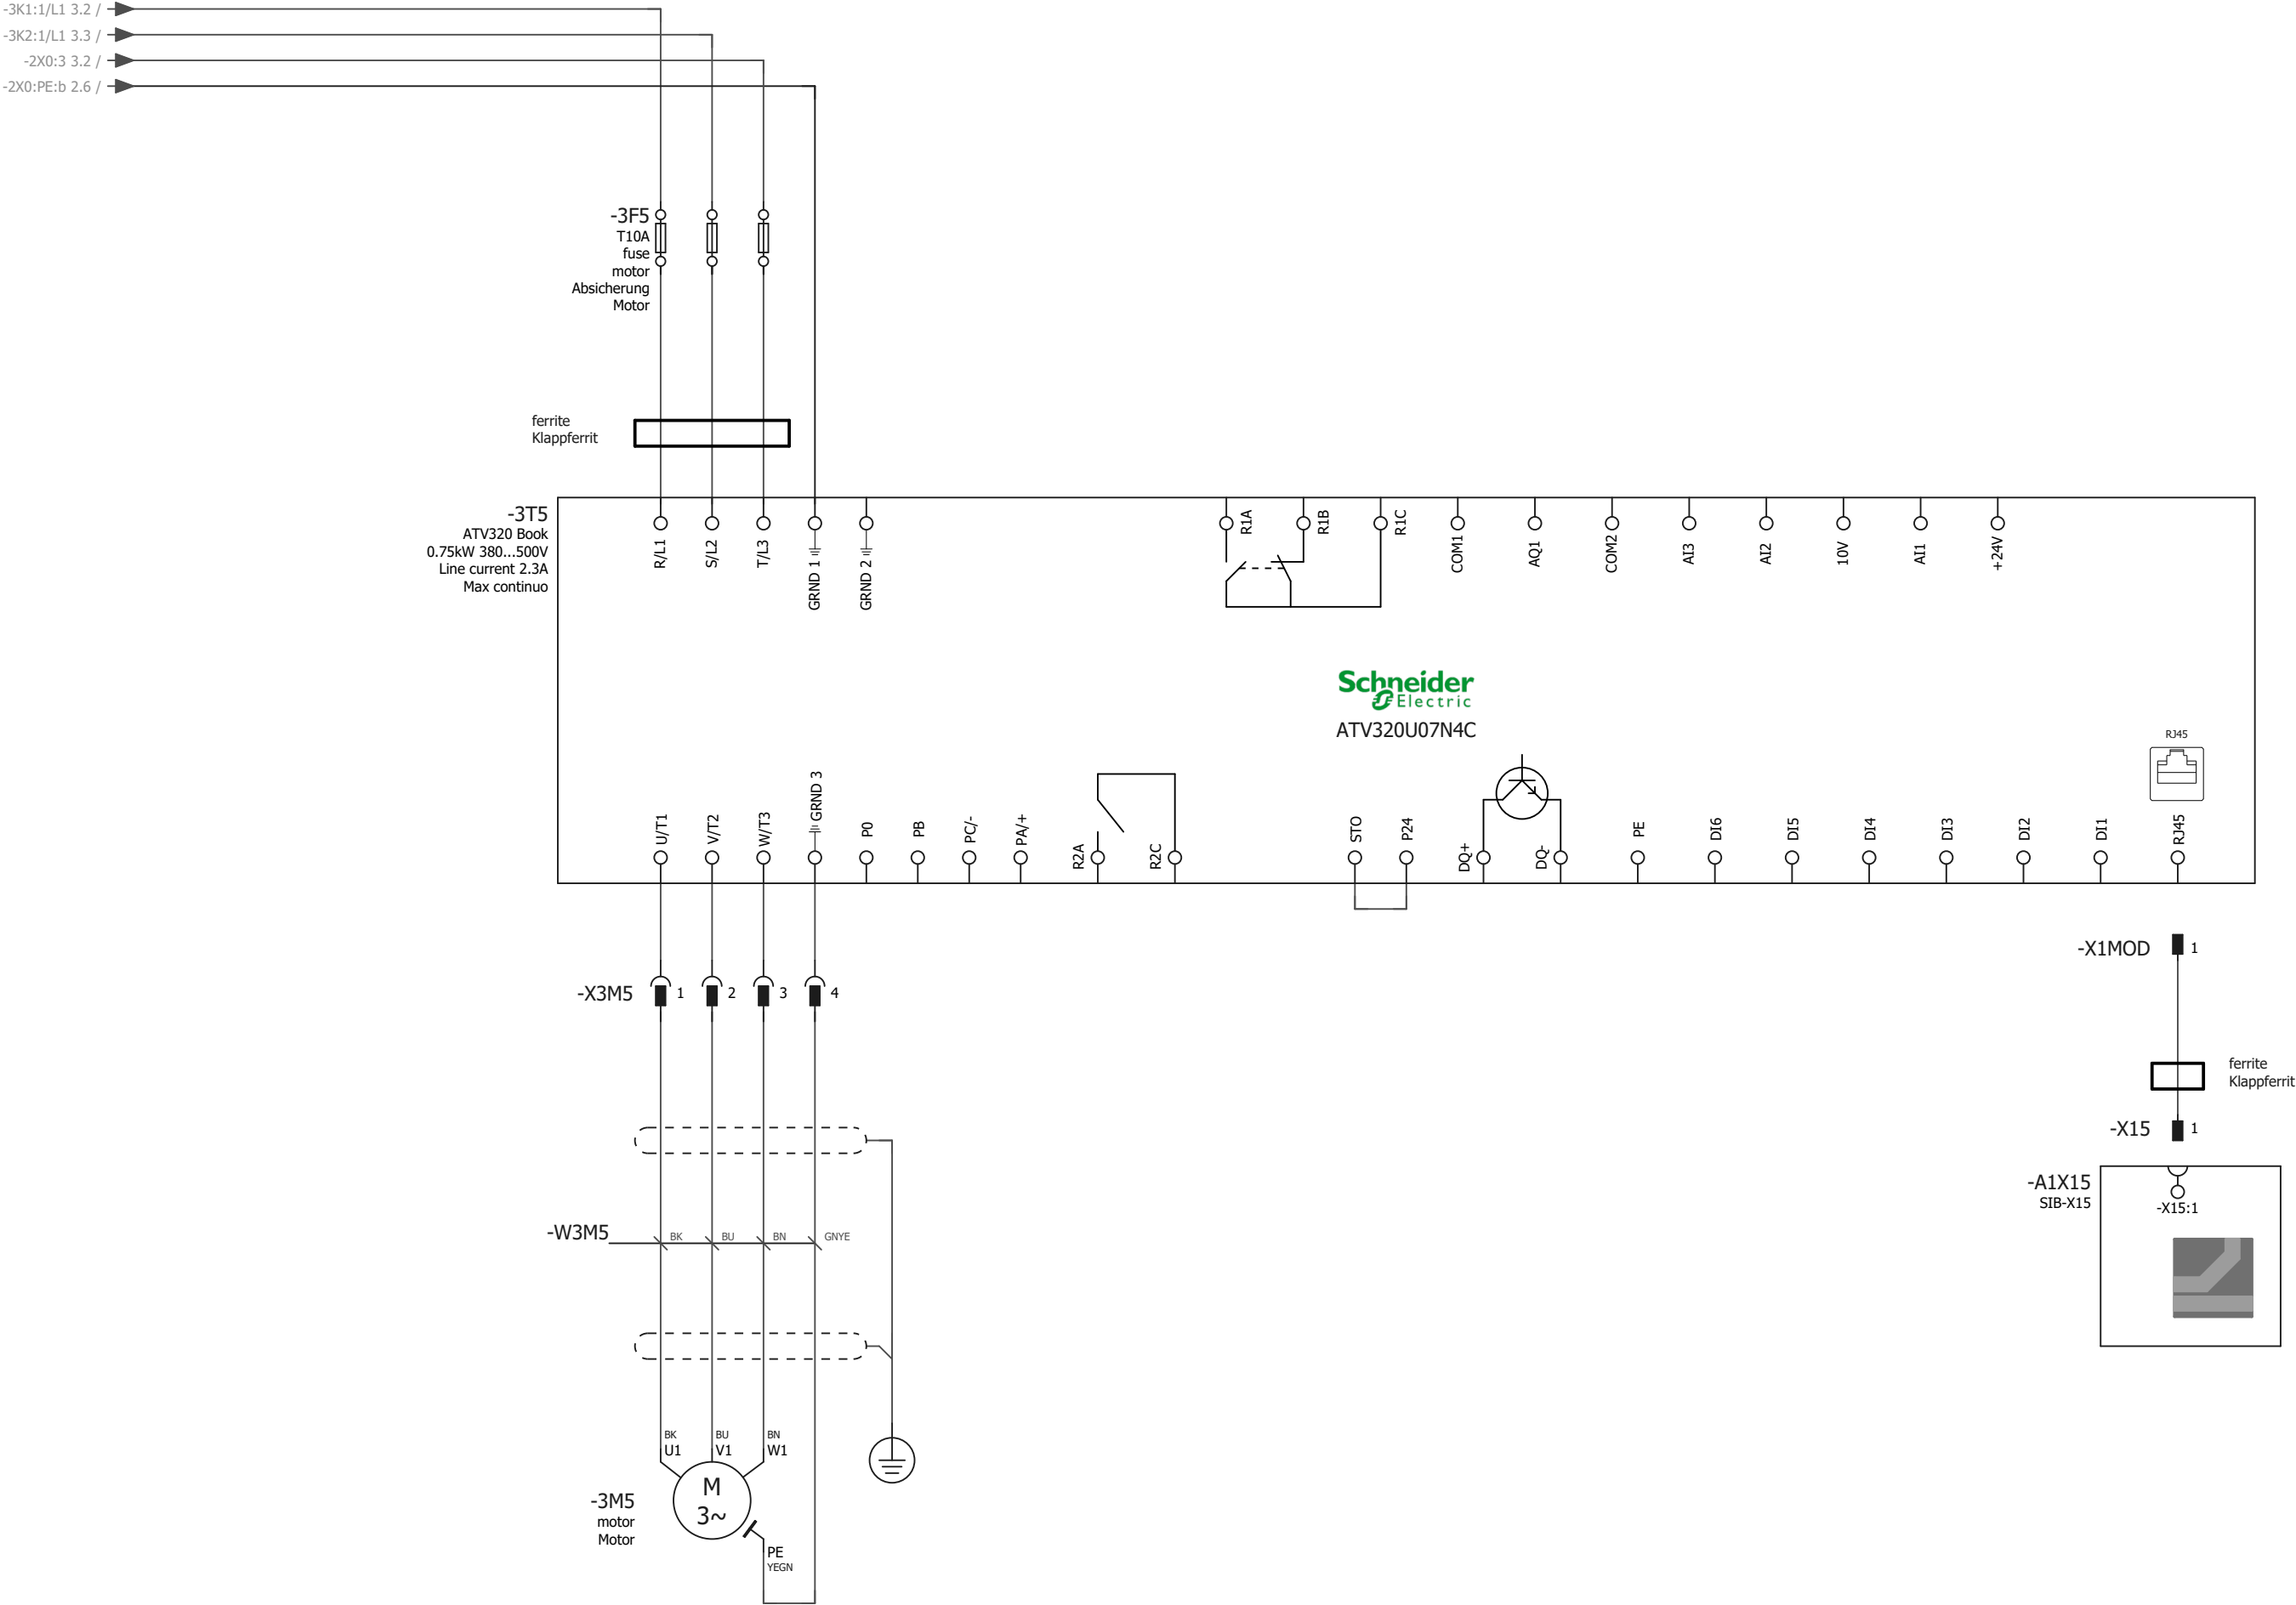

03	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 12.20 EB C4e 12.20 EB C4e 12.20 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	motor Motor	Project No. 5354158		= SLP	
02	ÄM071/2015	09.04.2015	SchM	Name	Boe				+ MPL			
01	ÄM107/2014	22.10.2014	SchM	App.	SchM				Drg. No. 5153102		Blatt 5	
REV	Remarks	Date	Name	Norm							Seite 5 / 12	

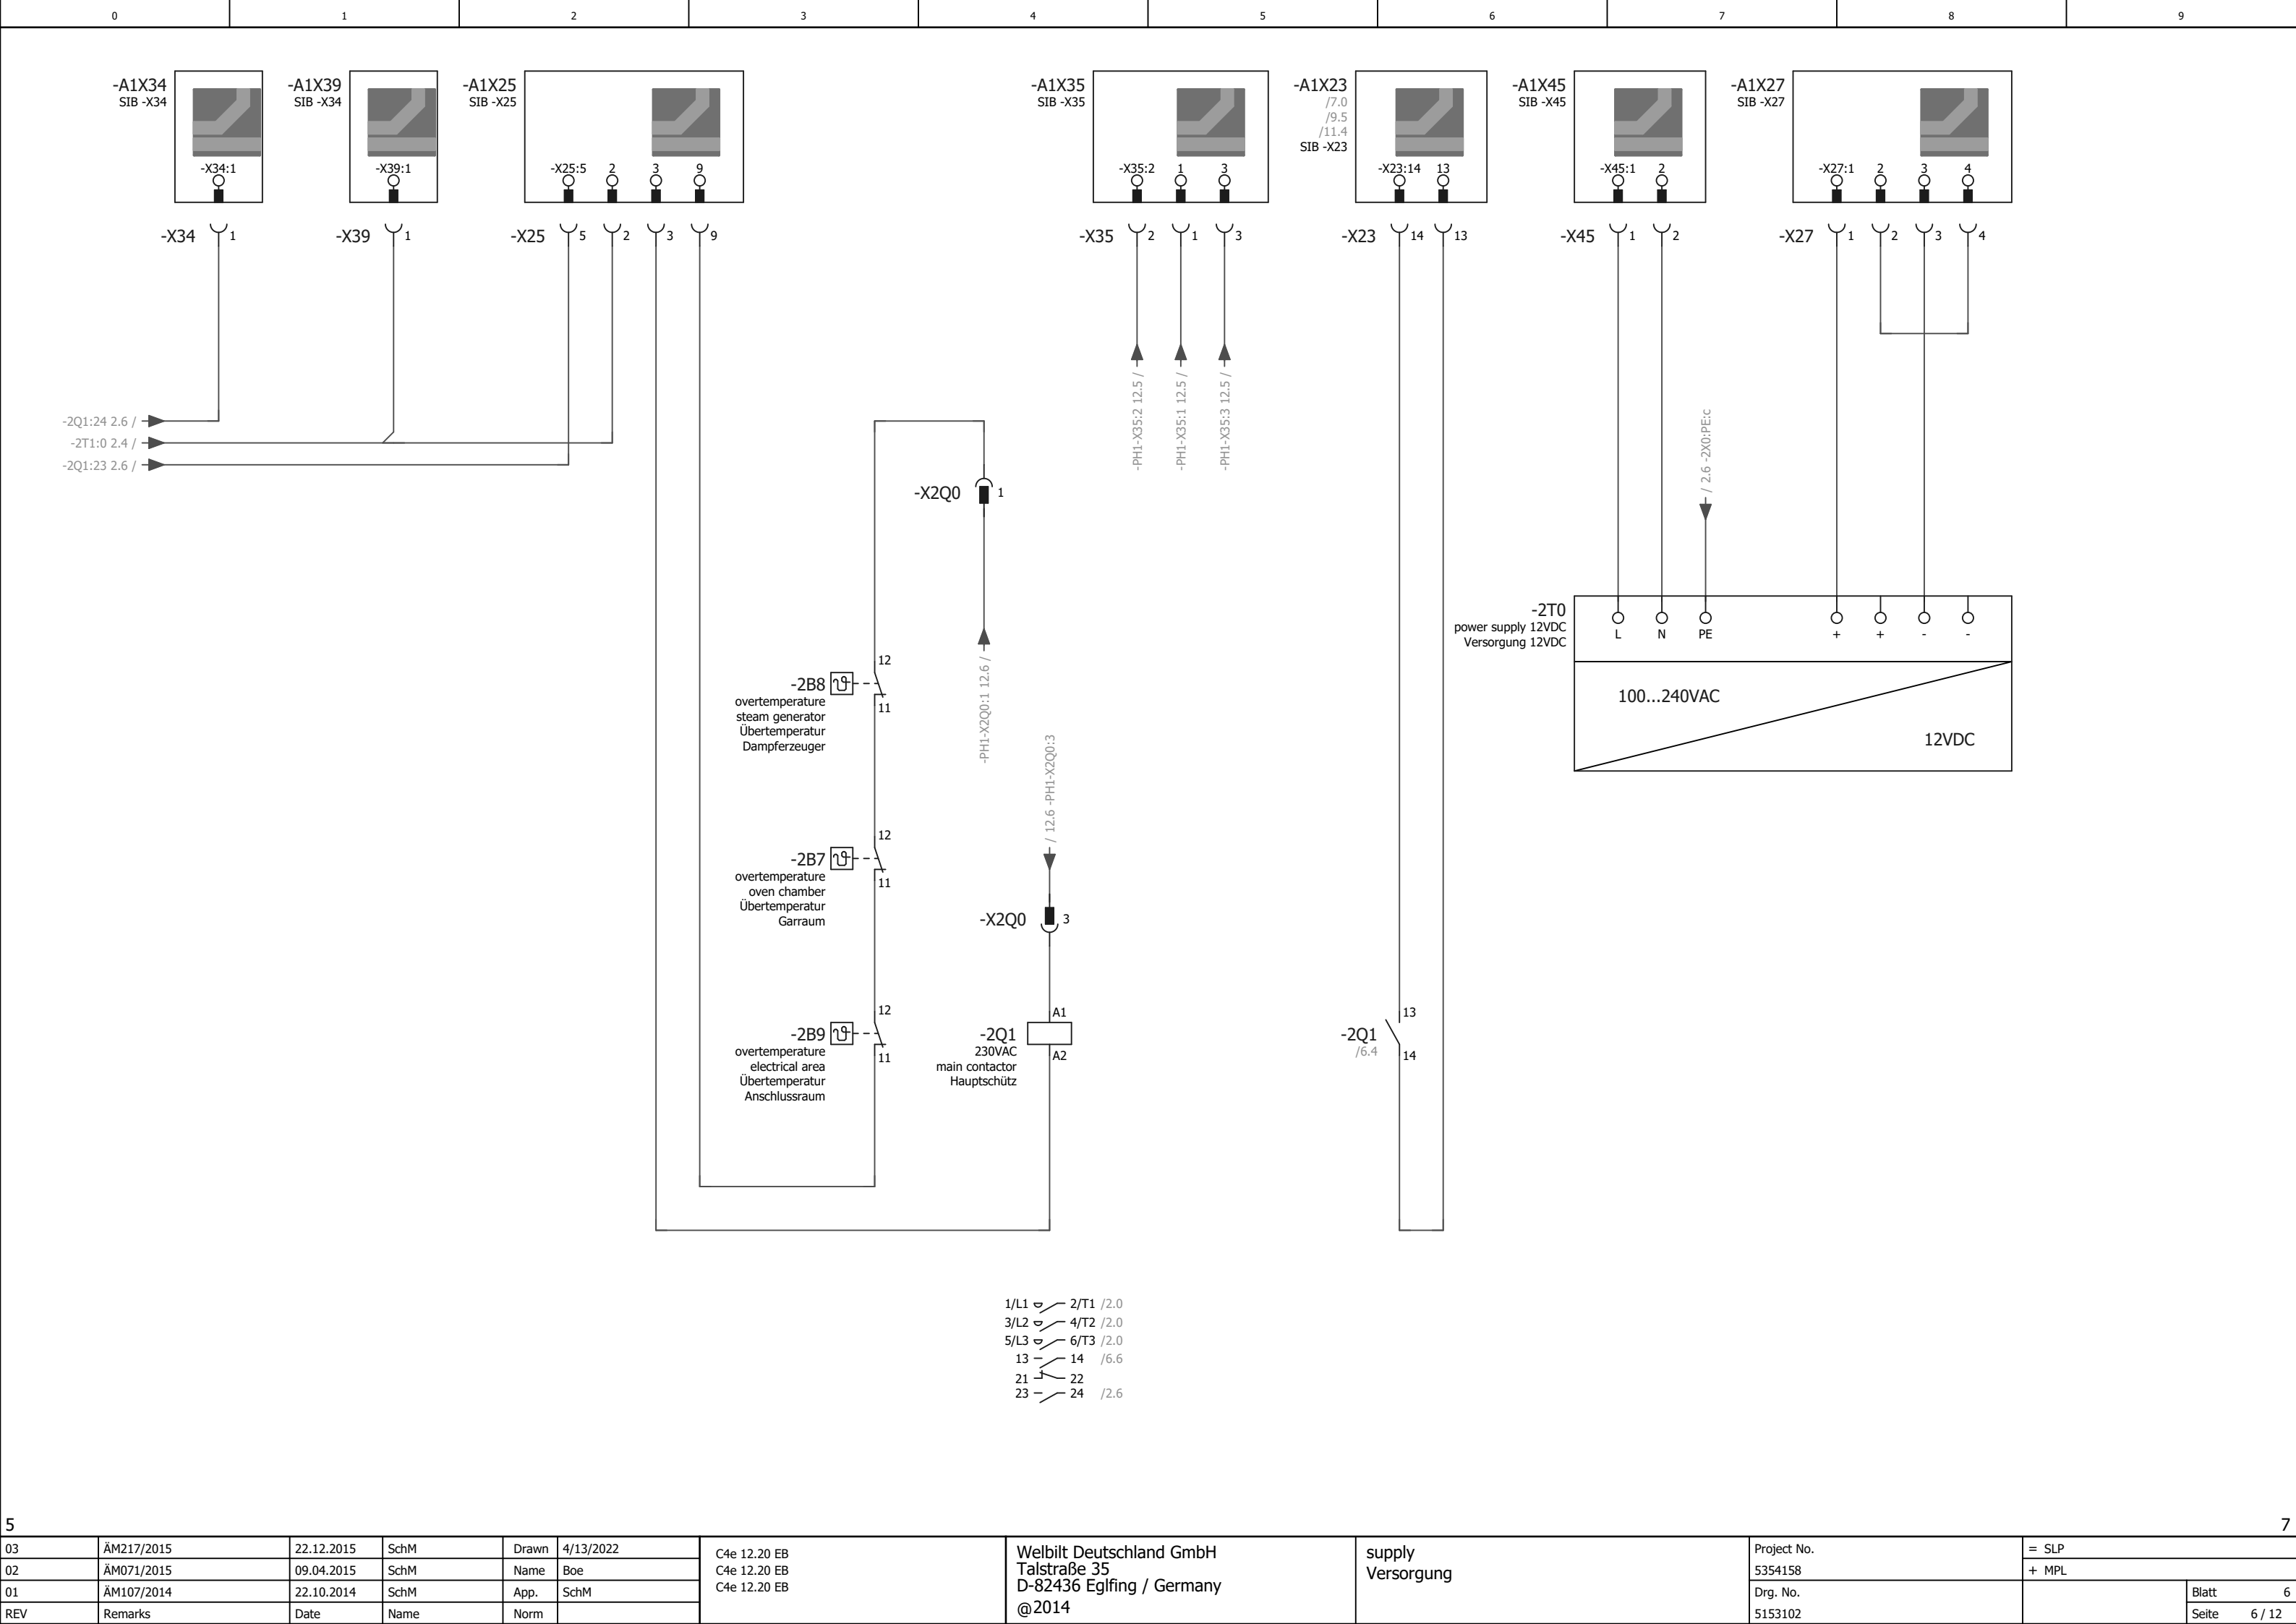

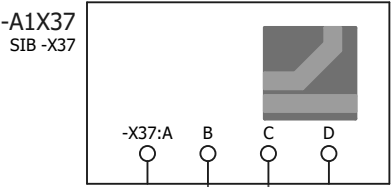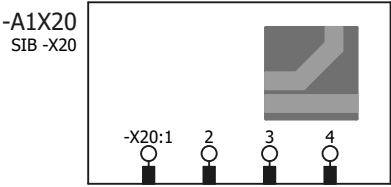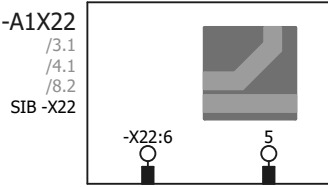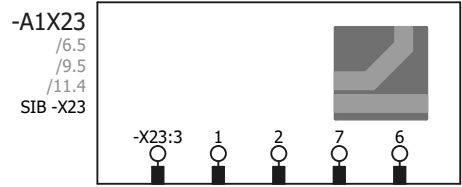

SICOTRONIC

