

electrical documentation  
Elektrodokumentation




type Gerätetyp	rated voltage Bemessungsspannung	frequency Frequenz	rated power Bemessungsaufnahme	rated current Bemessungsstrom
C4e 20.10 EB	3~400V	50/60Hz	38,9kW	56,2A
C4e 20.10 EB	3~440V	50/60Hz	32,6kW	42,8A
C4e 20.10 EB	3~480V	50/60Hz	38,6kW	46,5A

Welbilt Deutschland GmbH


Talstraße 35  
D-82436 Eglfing / Germany  
  
+49 (0)8847 - 67 - 0  
  
+49 (0)8847 - 67 - 414  
  
www.convotherm.com


fuses on site!  
Please look at local supply regulations!  
Absicherung bauseits!  
Örtliche EVU-Vorschriften beachten!

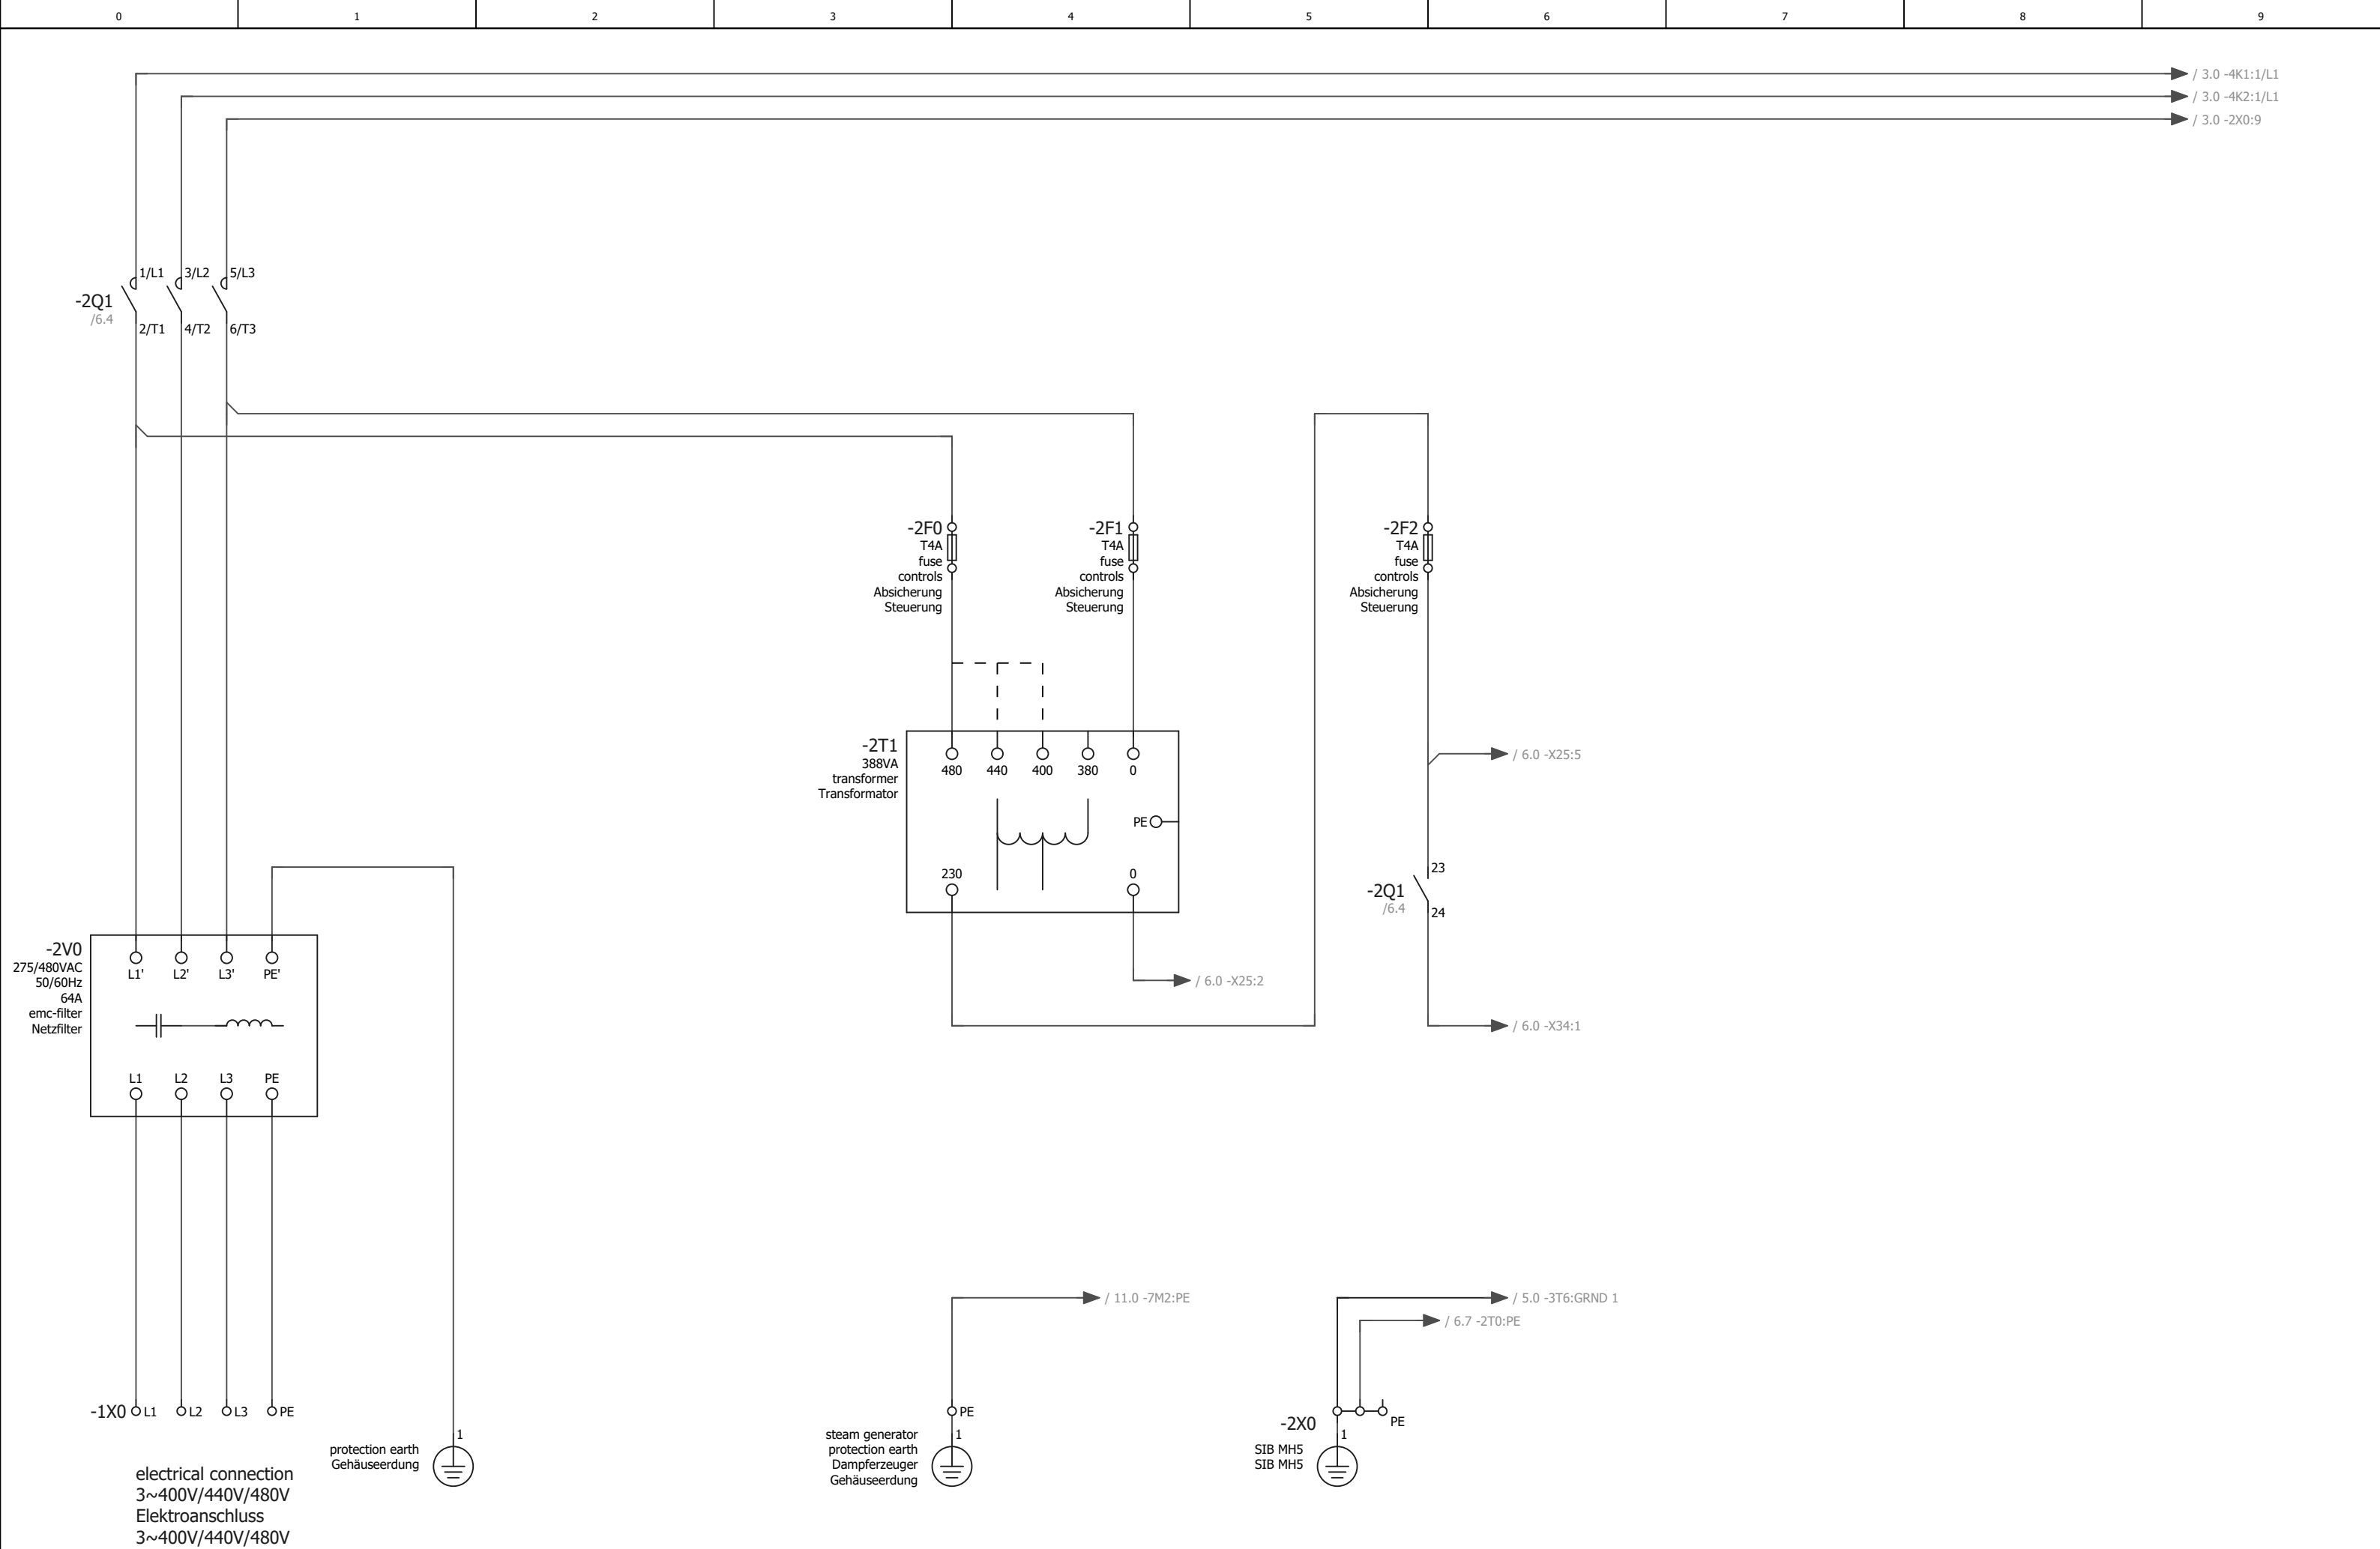


1						3						
04	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 20.10 EB C4e 20.10 EB C4e 20.10 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	supply Einspeisung	Project No.		= SLP	
03	ÄM145/2015	10.09.2015	SchM	Name	Boe				5354159		+ MPL	
02	ÄM071/2015	09.04.2015	SchM	App.	SchM				Drg. No.		Blatt 2	
REV	Remarks	Date	Name	Norm					5153103		Seite 2 / 13	


04	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 20.10 EB C4e 20.10 EB C4e 20.10 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	convection Heissluft	Project No. 5354159		= SLP	
03	ÄM145/2015	10.09.2015	SchM	Name	Boe				+ MPL			
02	ÄM071/2015	09.04.2015	SchM	App.	SchM				Drg. No. 5153103		Blatt	3
REV	Remarks	Date	Name	Norm							Seite	3 / 13

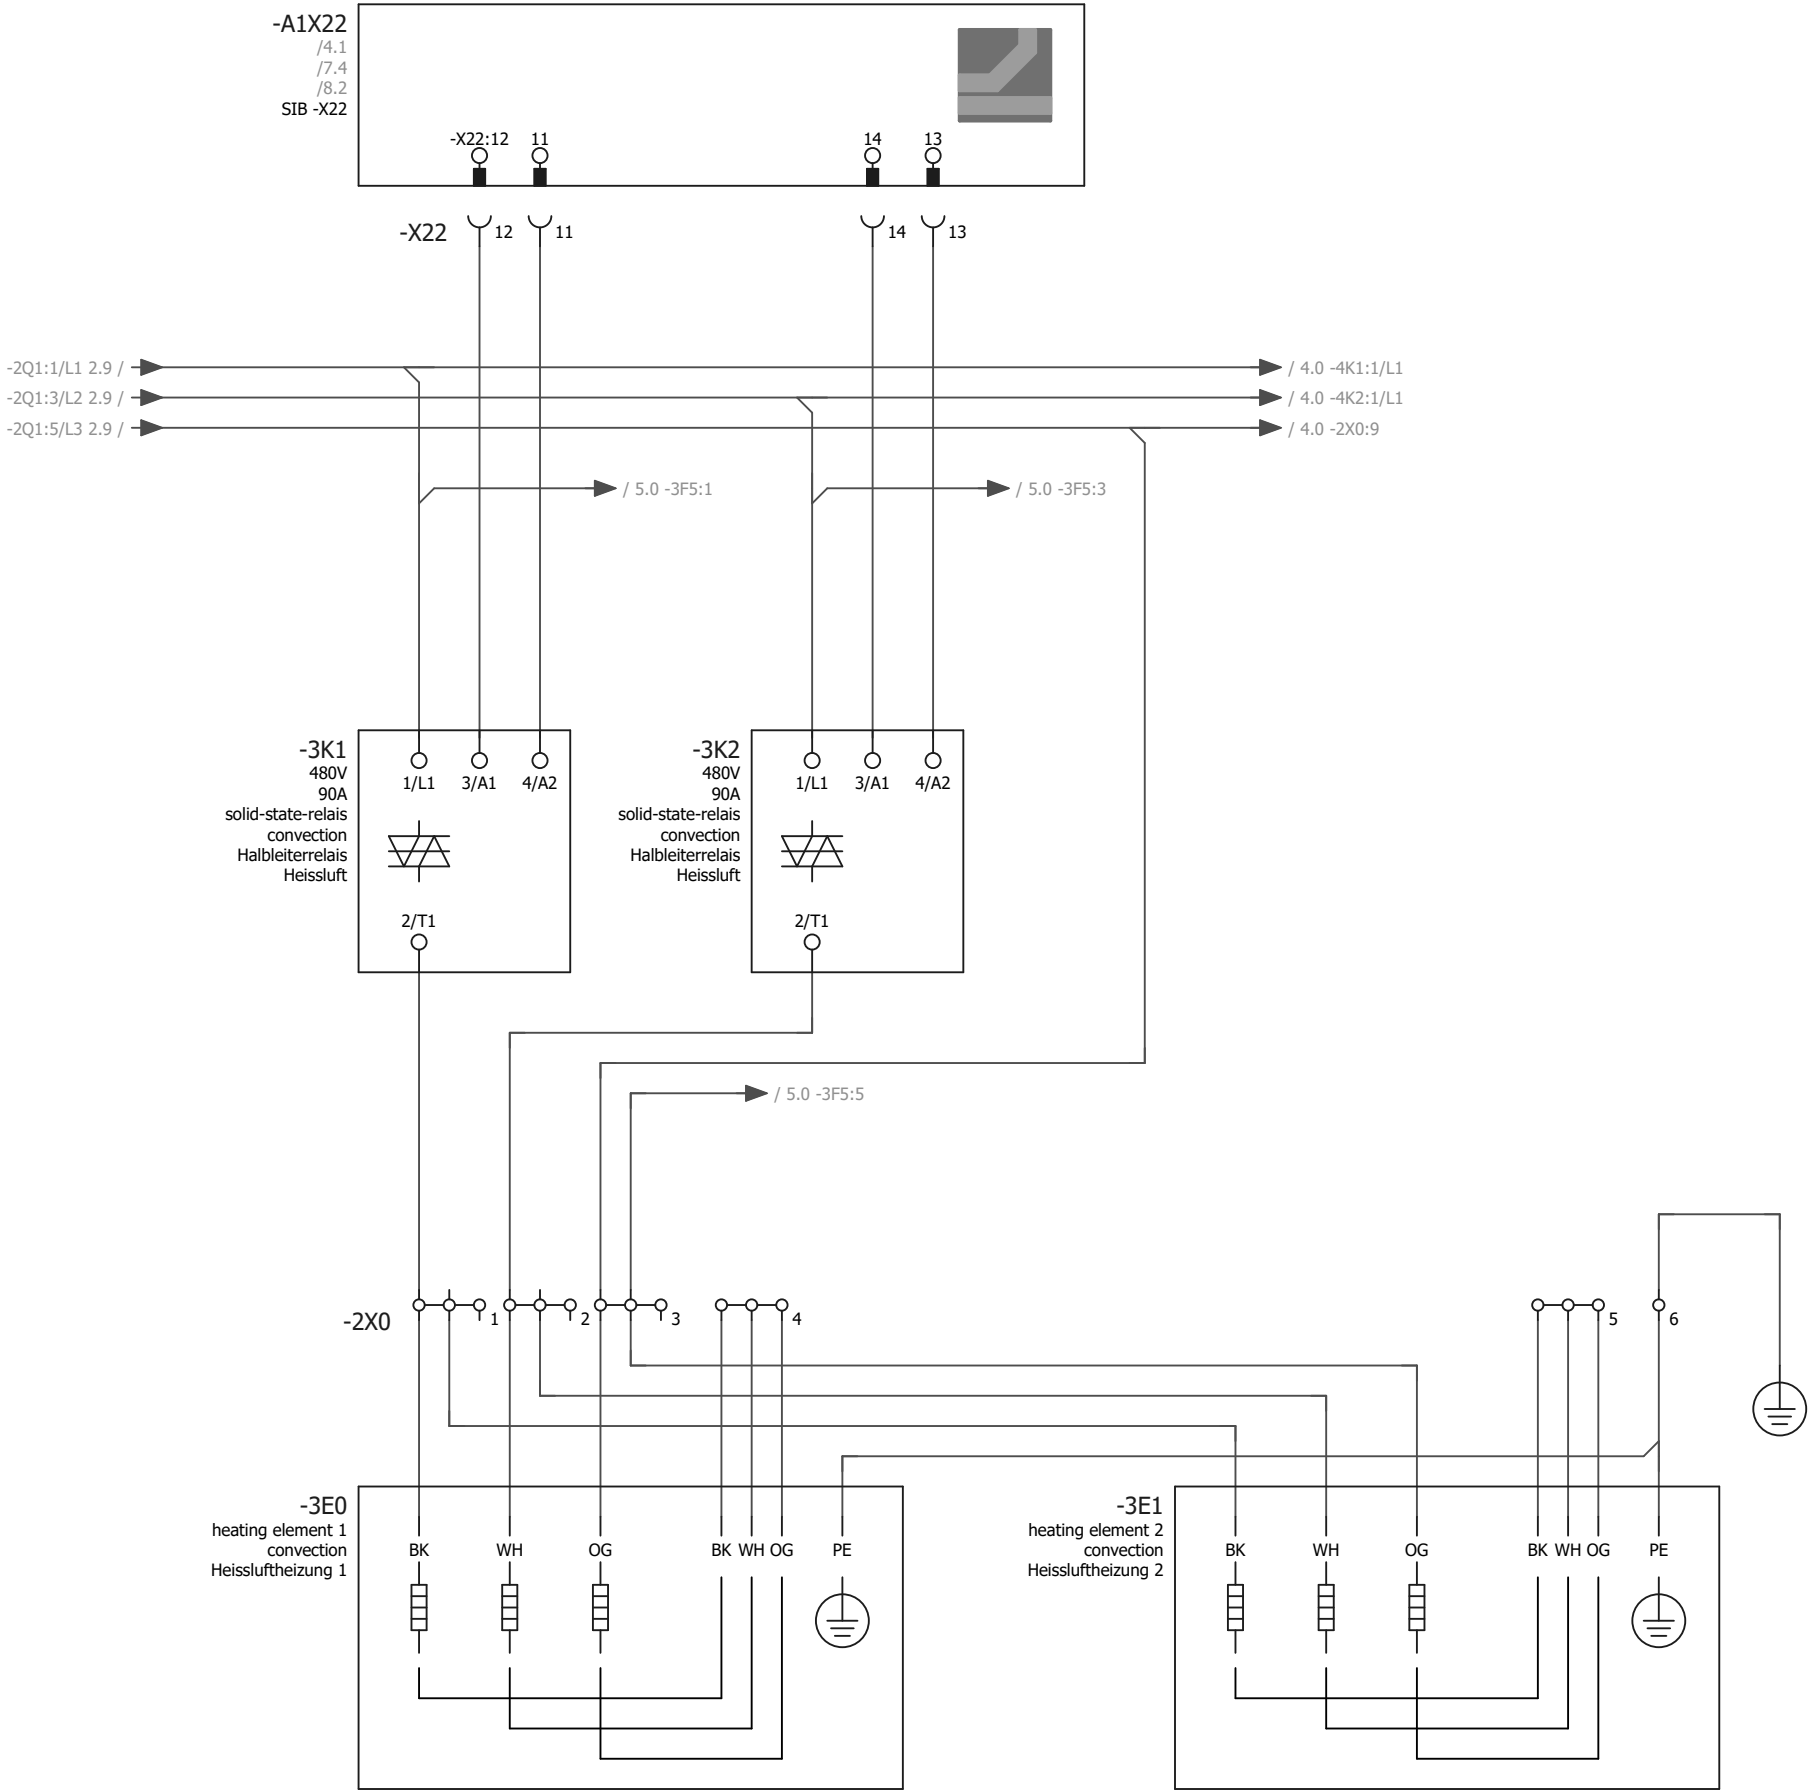





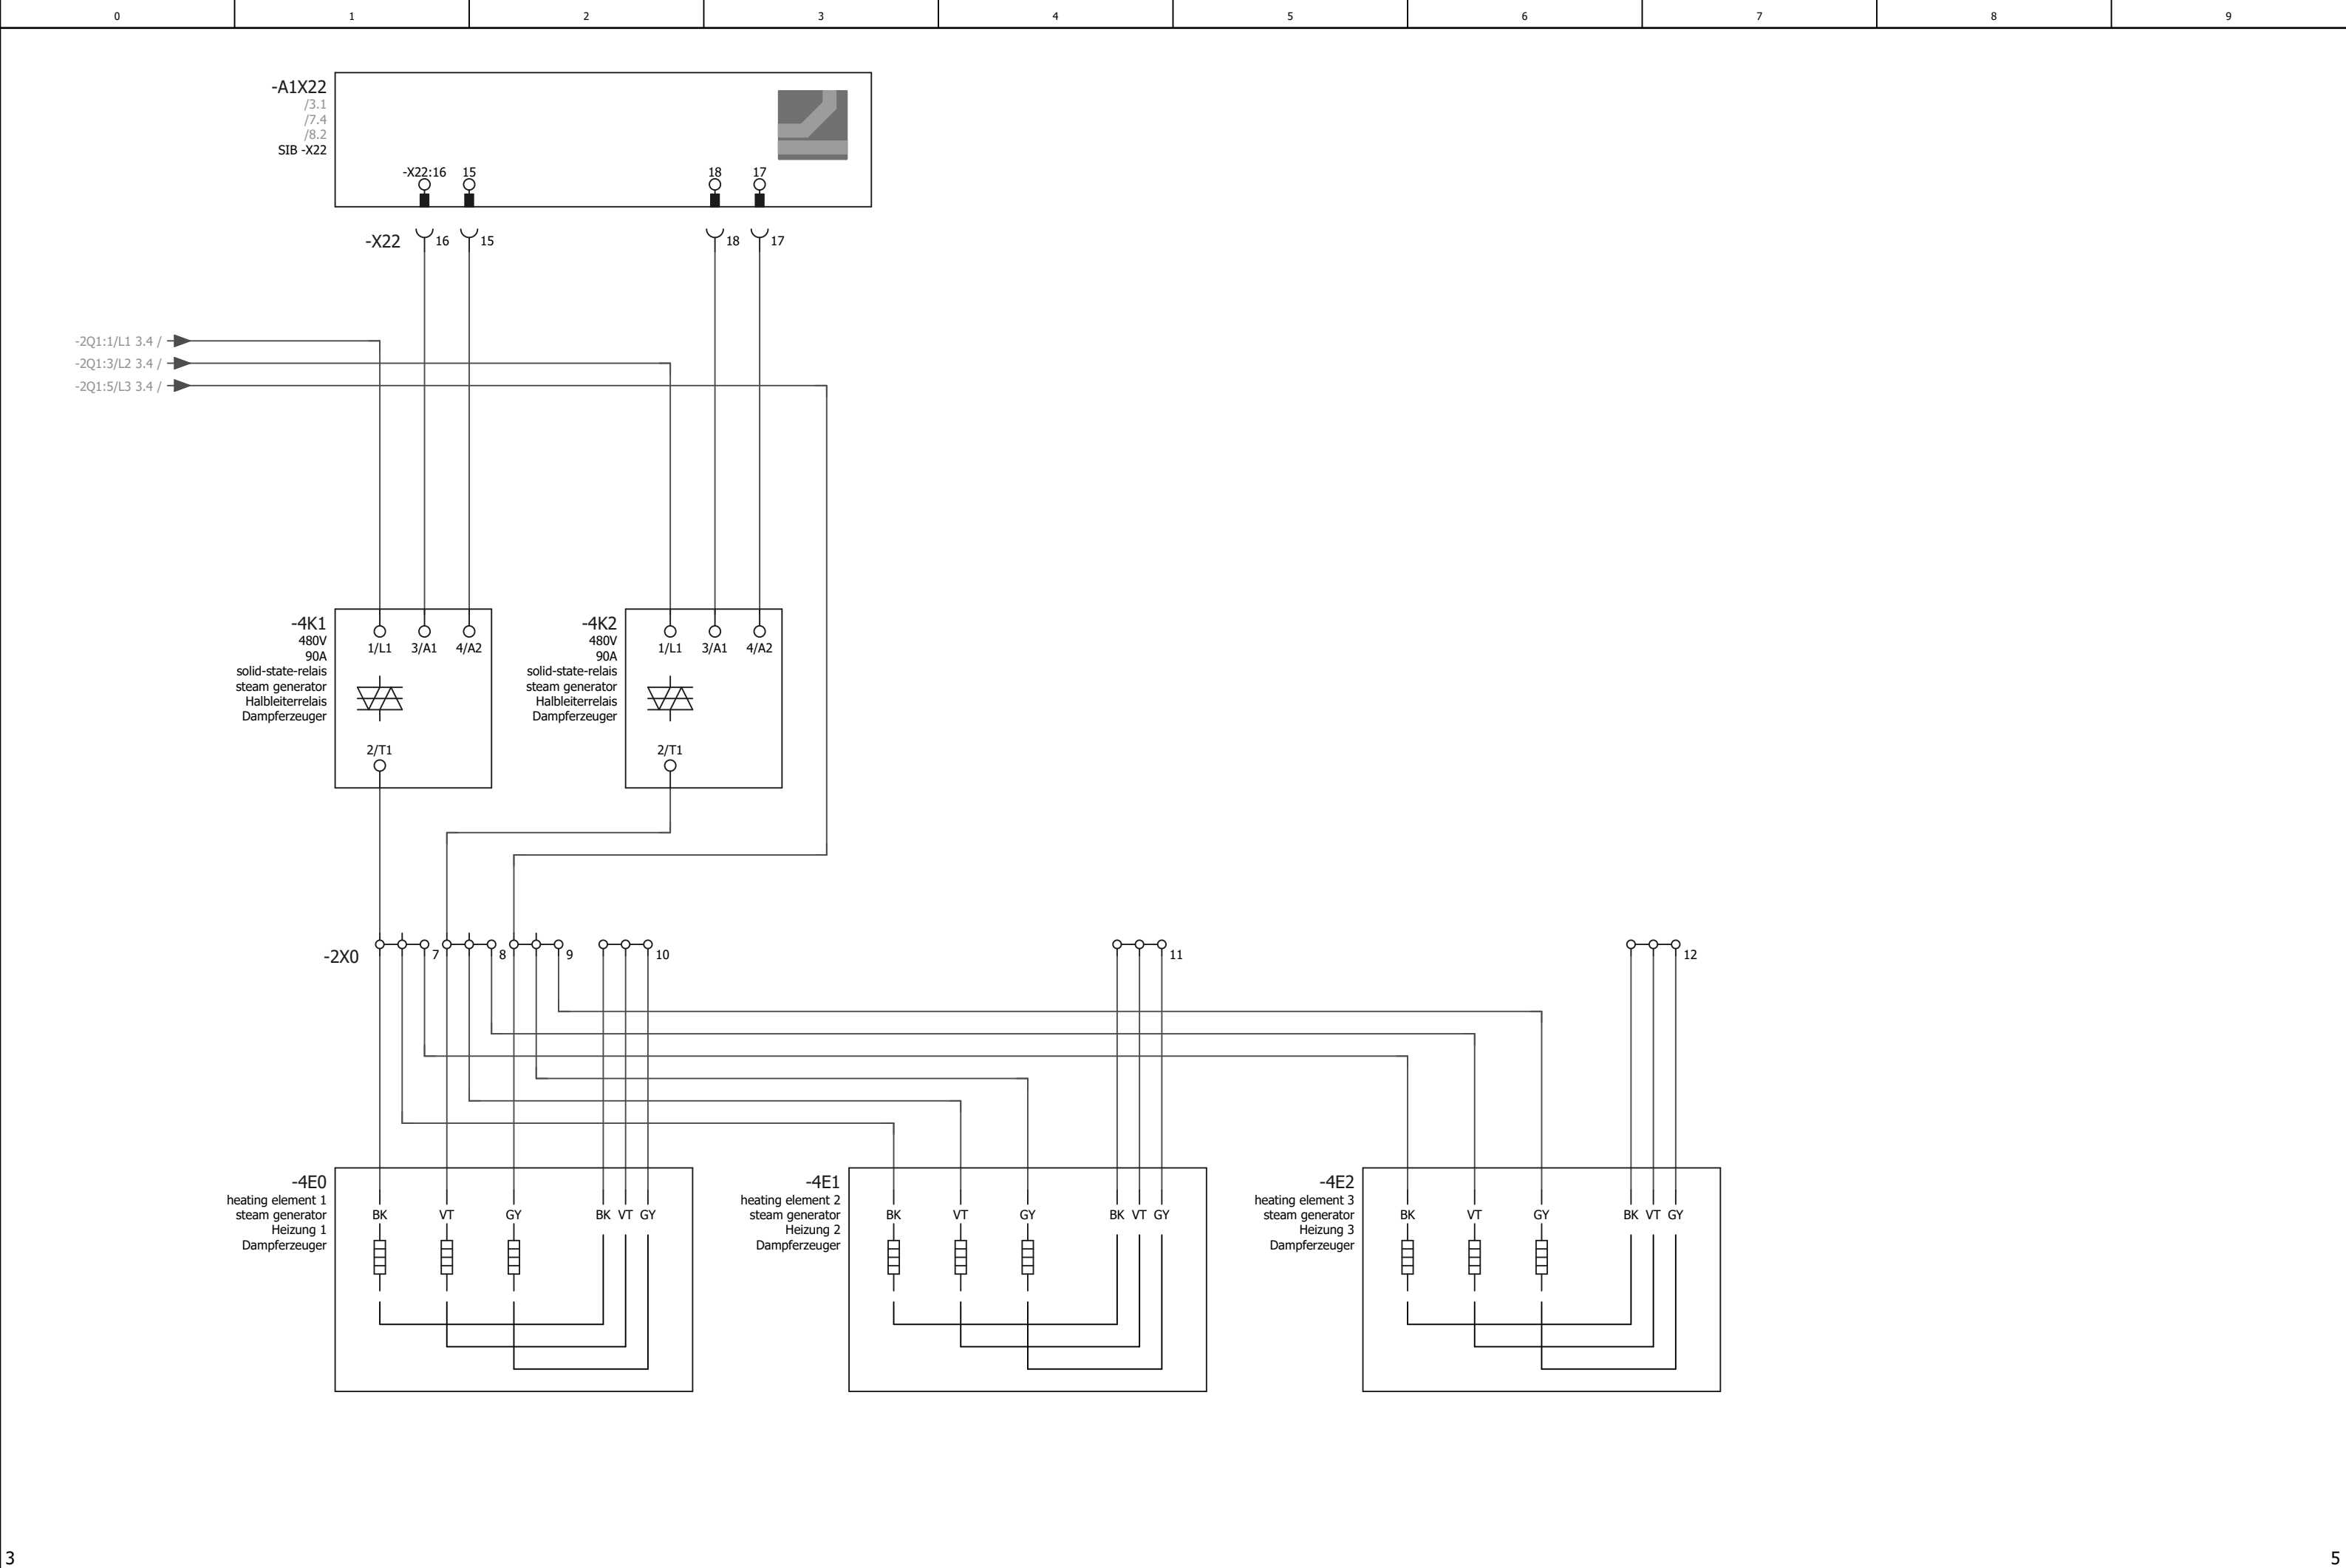


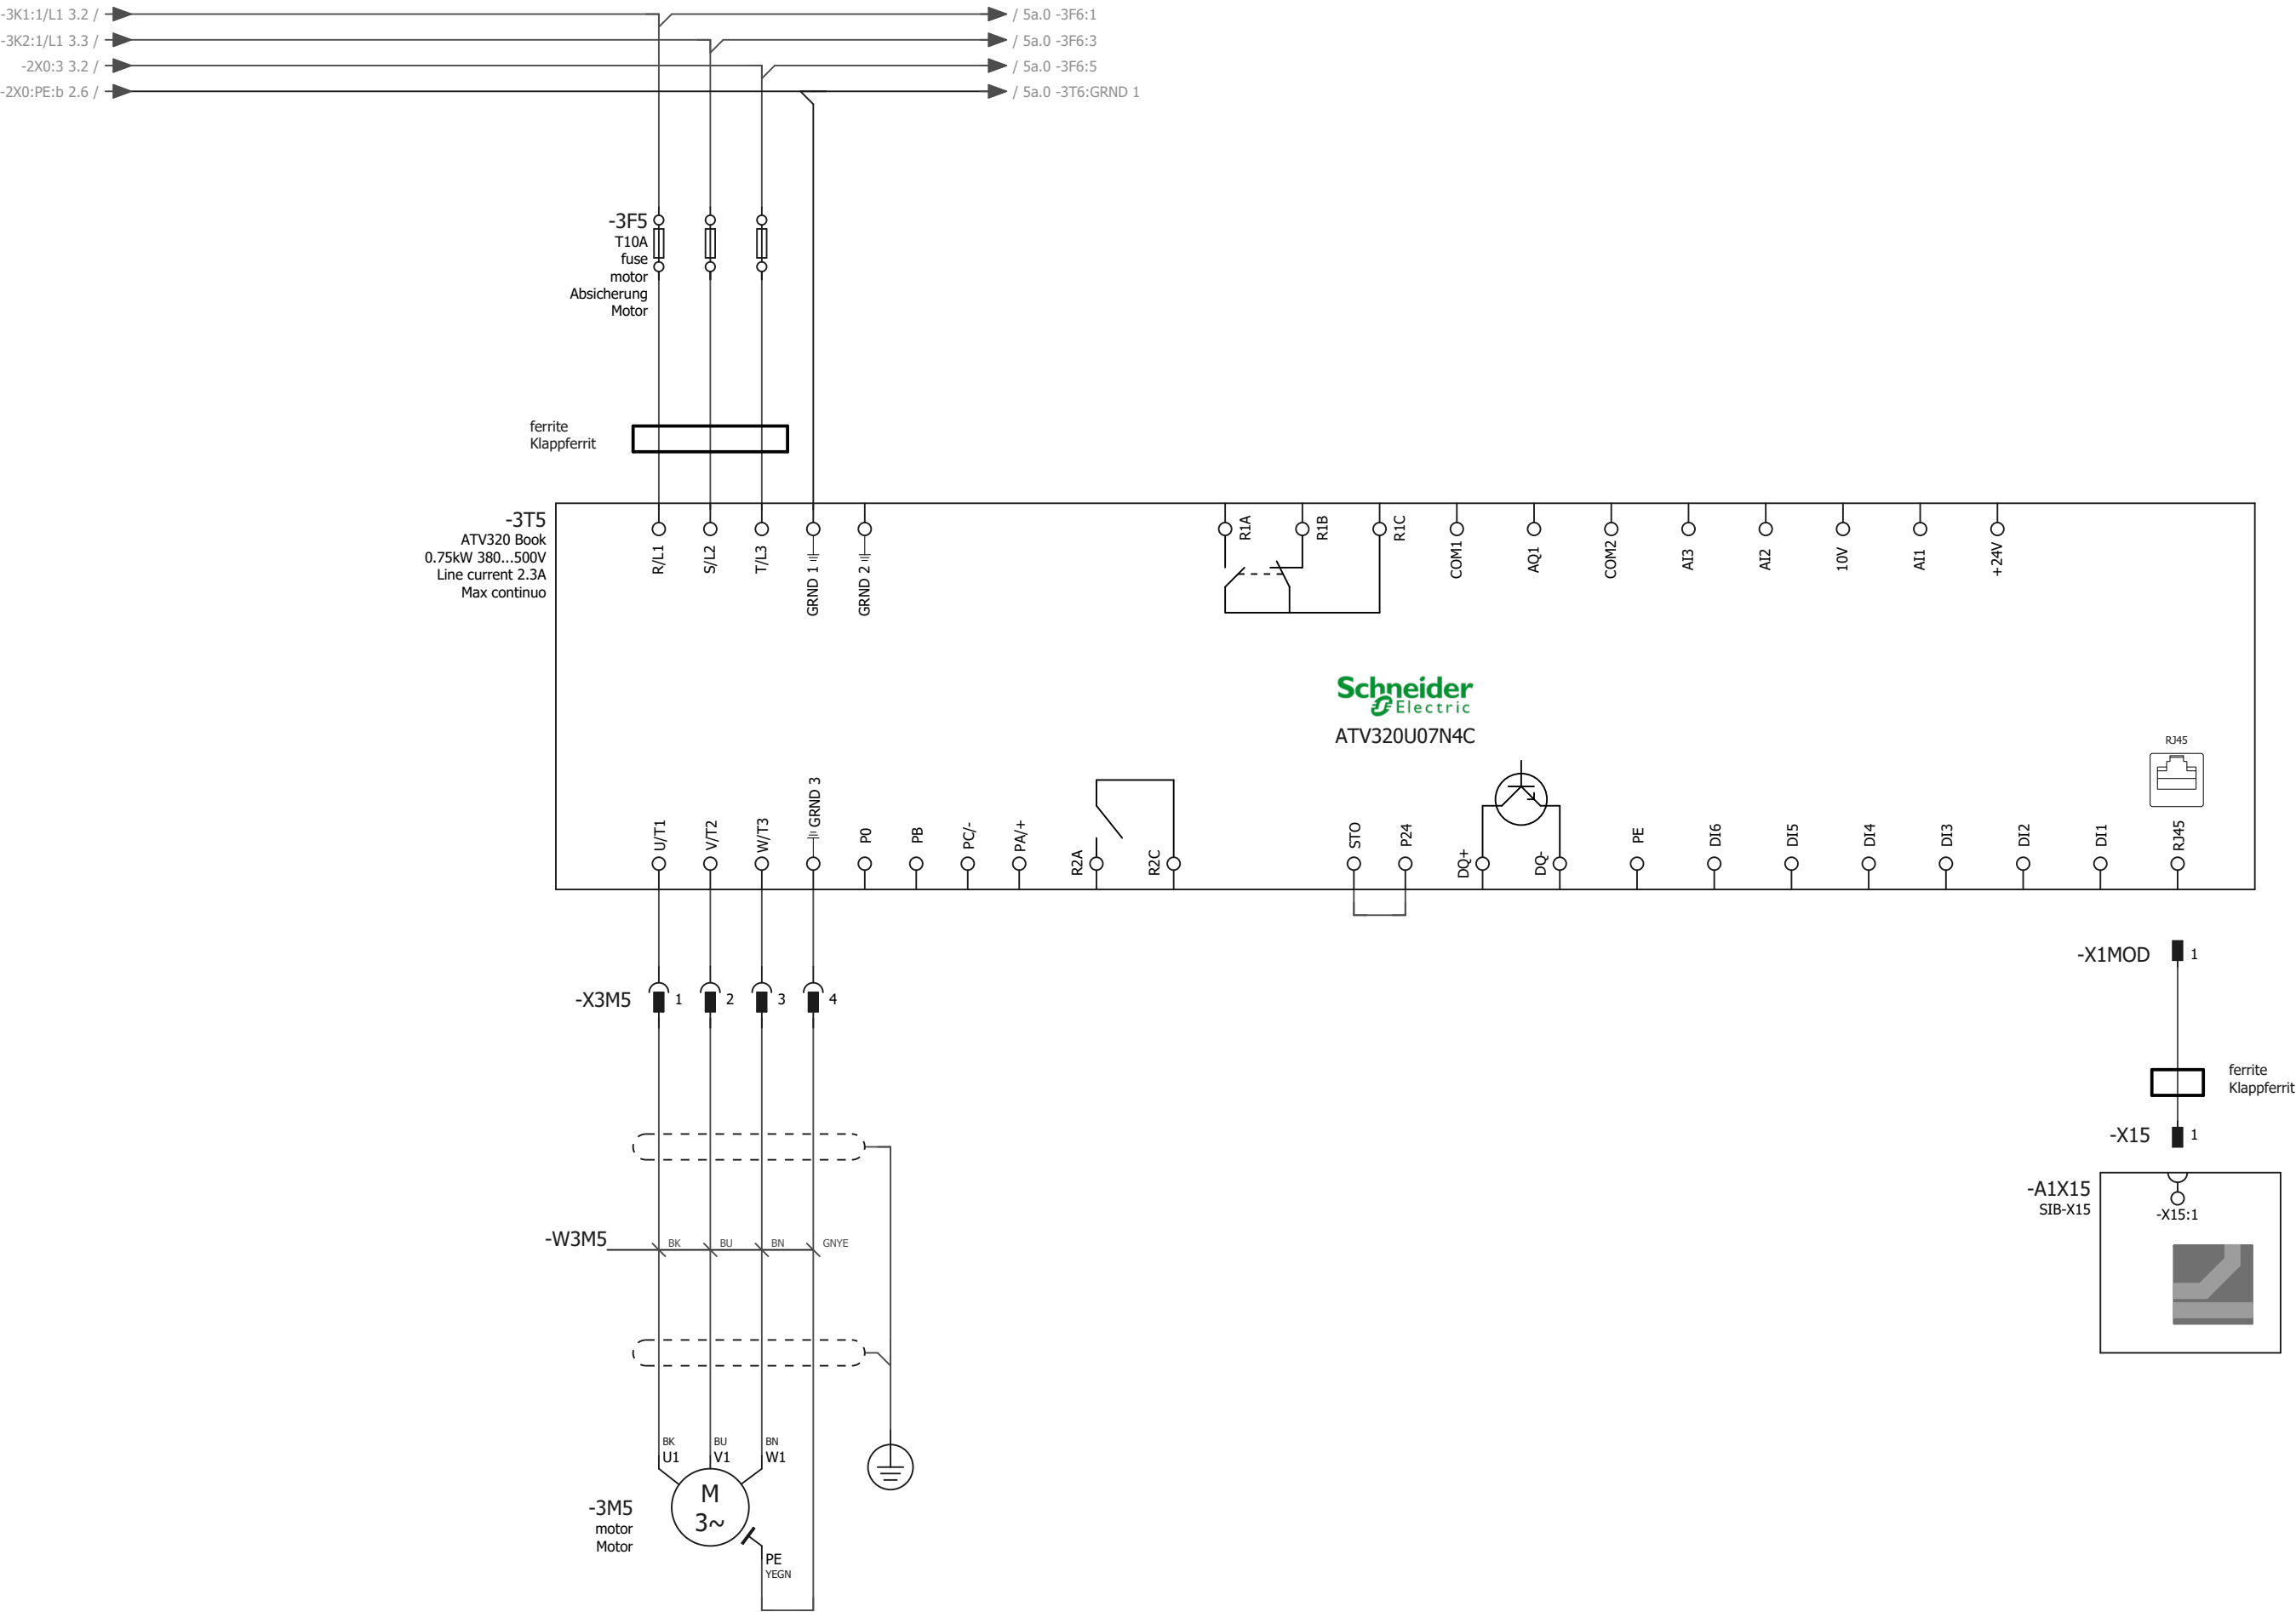

04	ÄM217/2015	22.12.2015	SchM	Drawn	4/13/2022	C4e 20.10 EB C4e 20.10 EB C4e 20.10 EB	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	motor Motor	Project No. 5354159		= SLP	
03	ÄM145/2015	10.09.2015	SchM	Name	Boe				+ MPL			
02	ÄM071/2015	09.04.2015	SchM	App.	SchM				Drg. No. 5153103		Blatt 5a	
REV	Remarks	Date	Name	Norm							Seite 6 / 13	

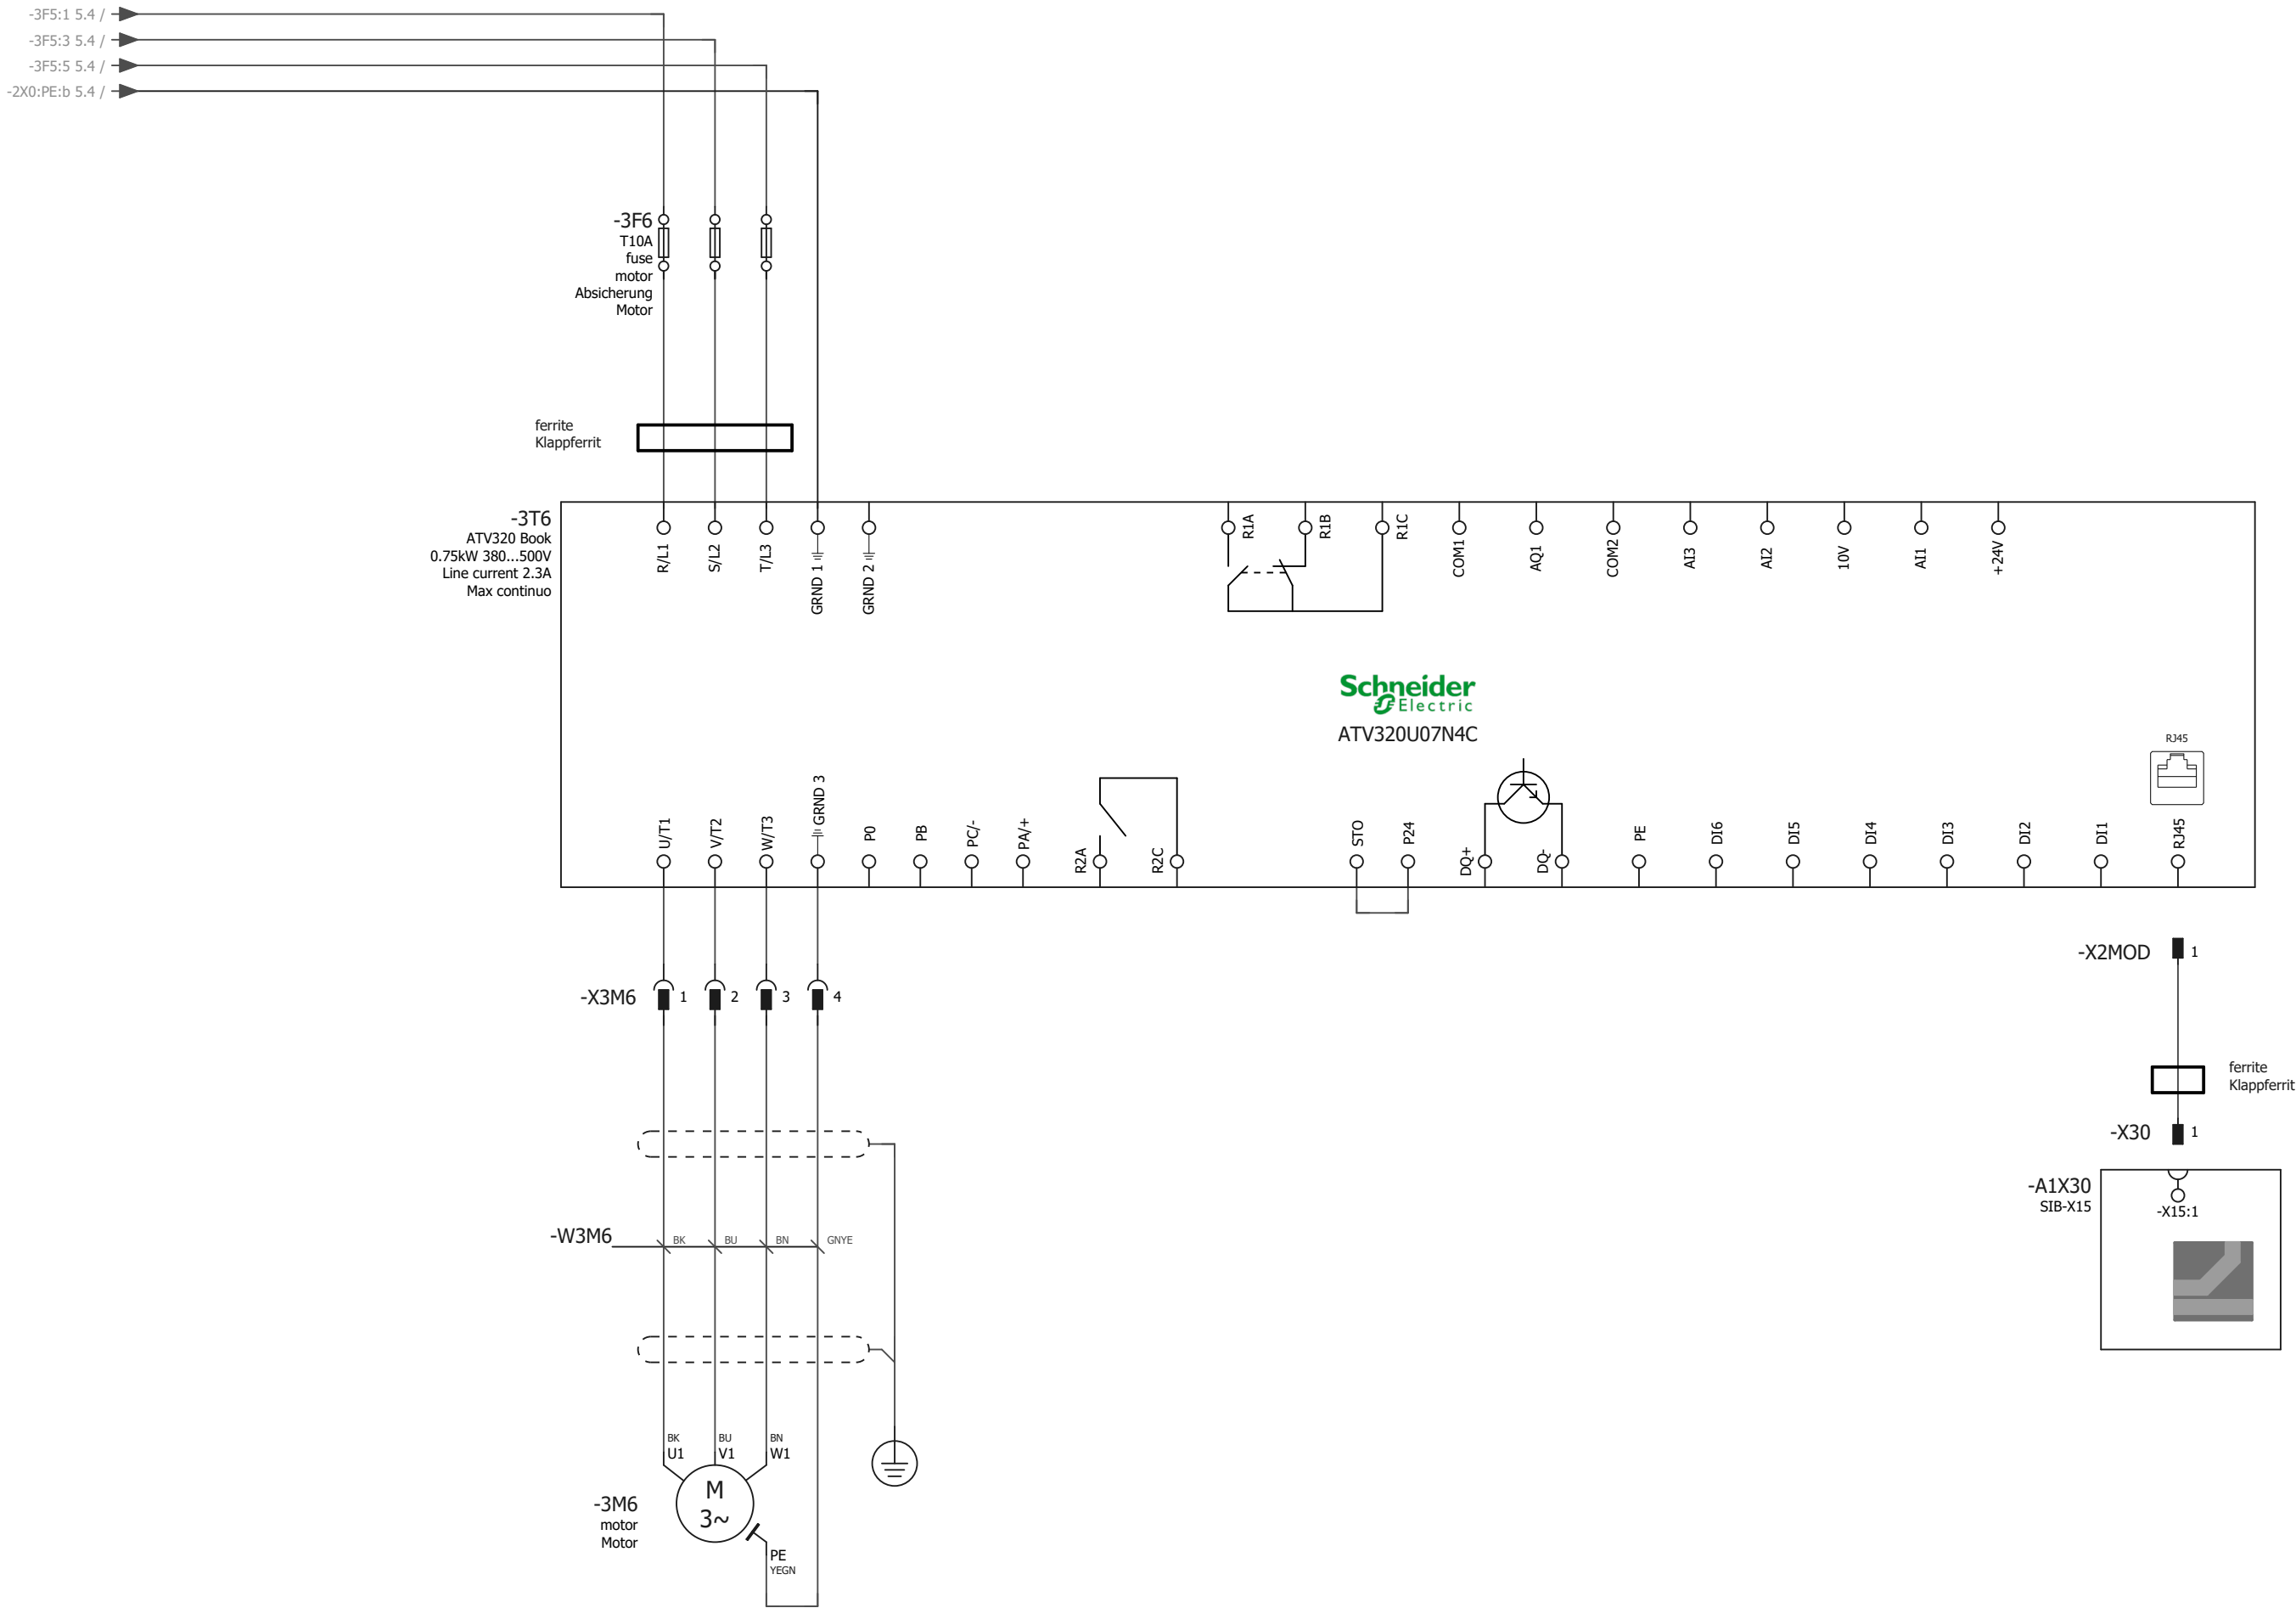

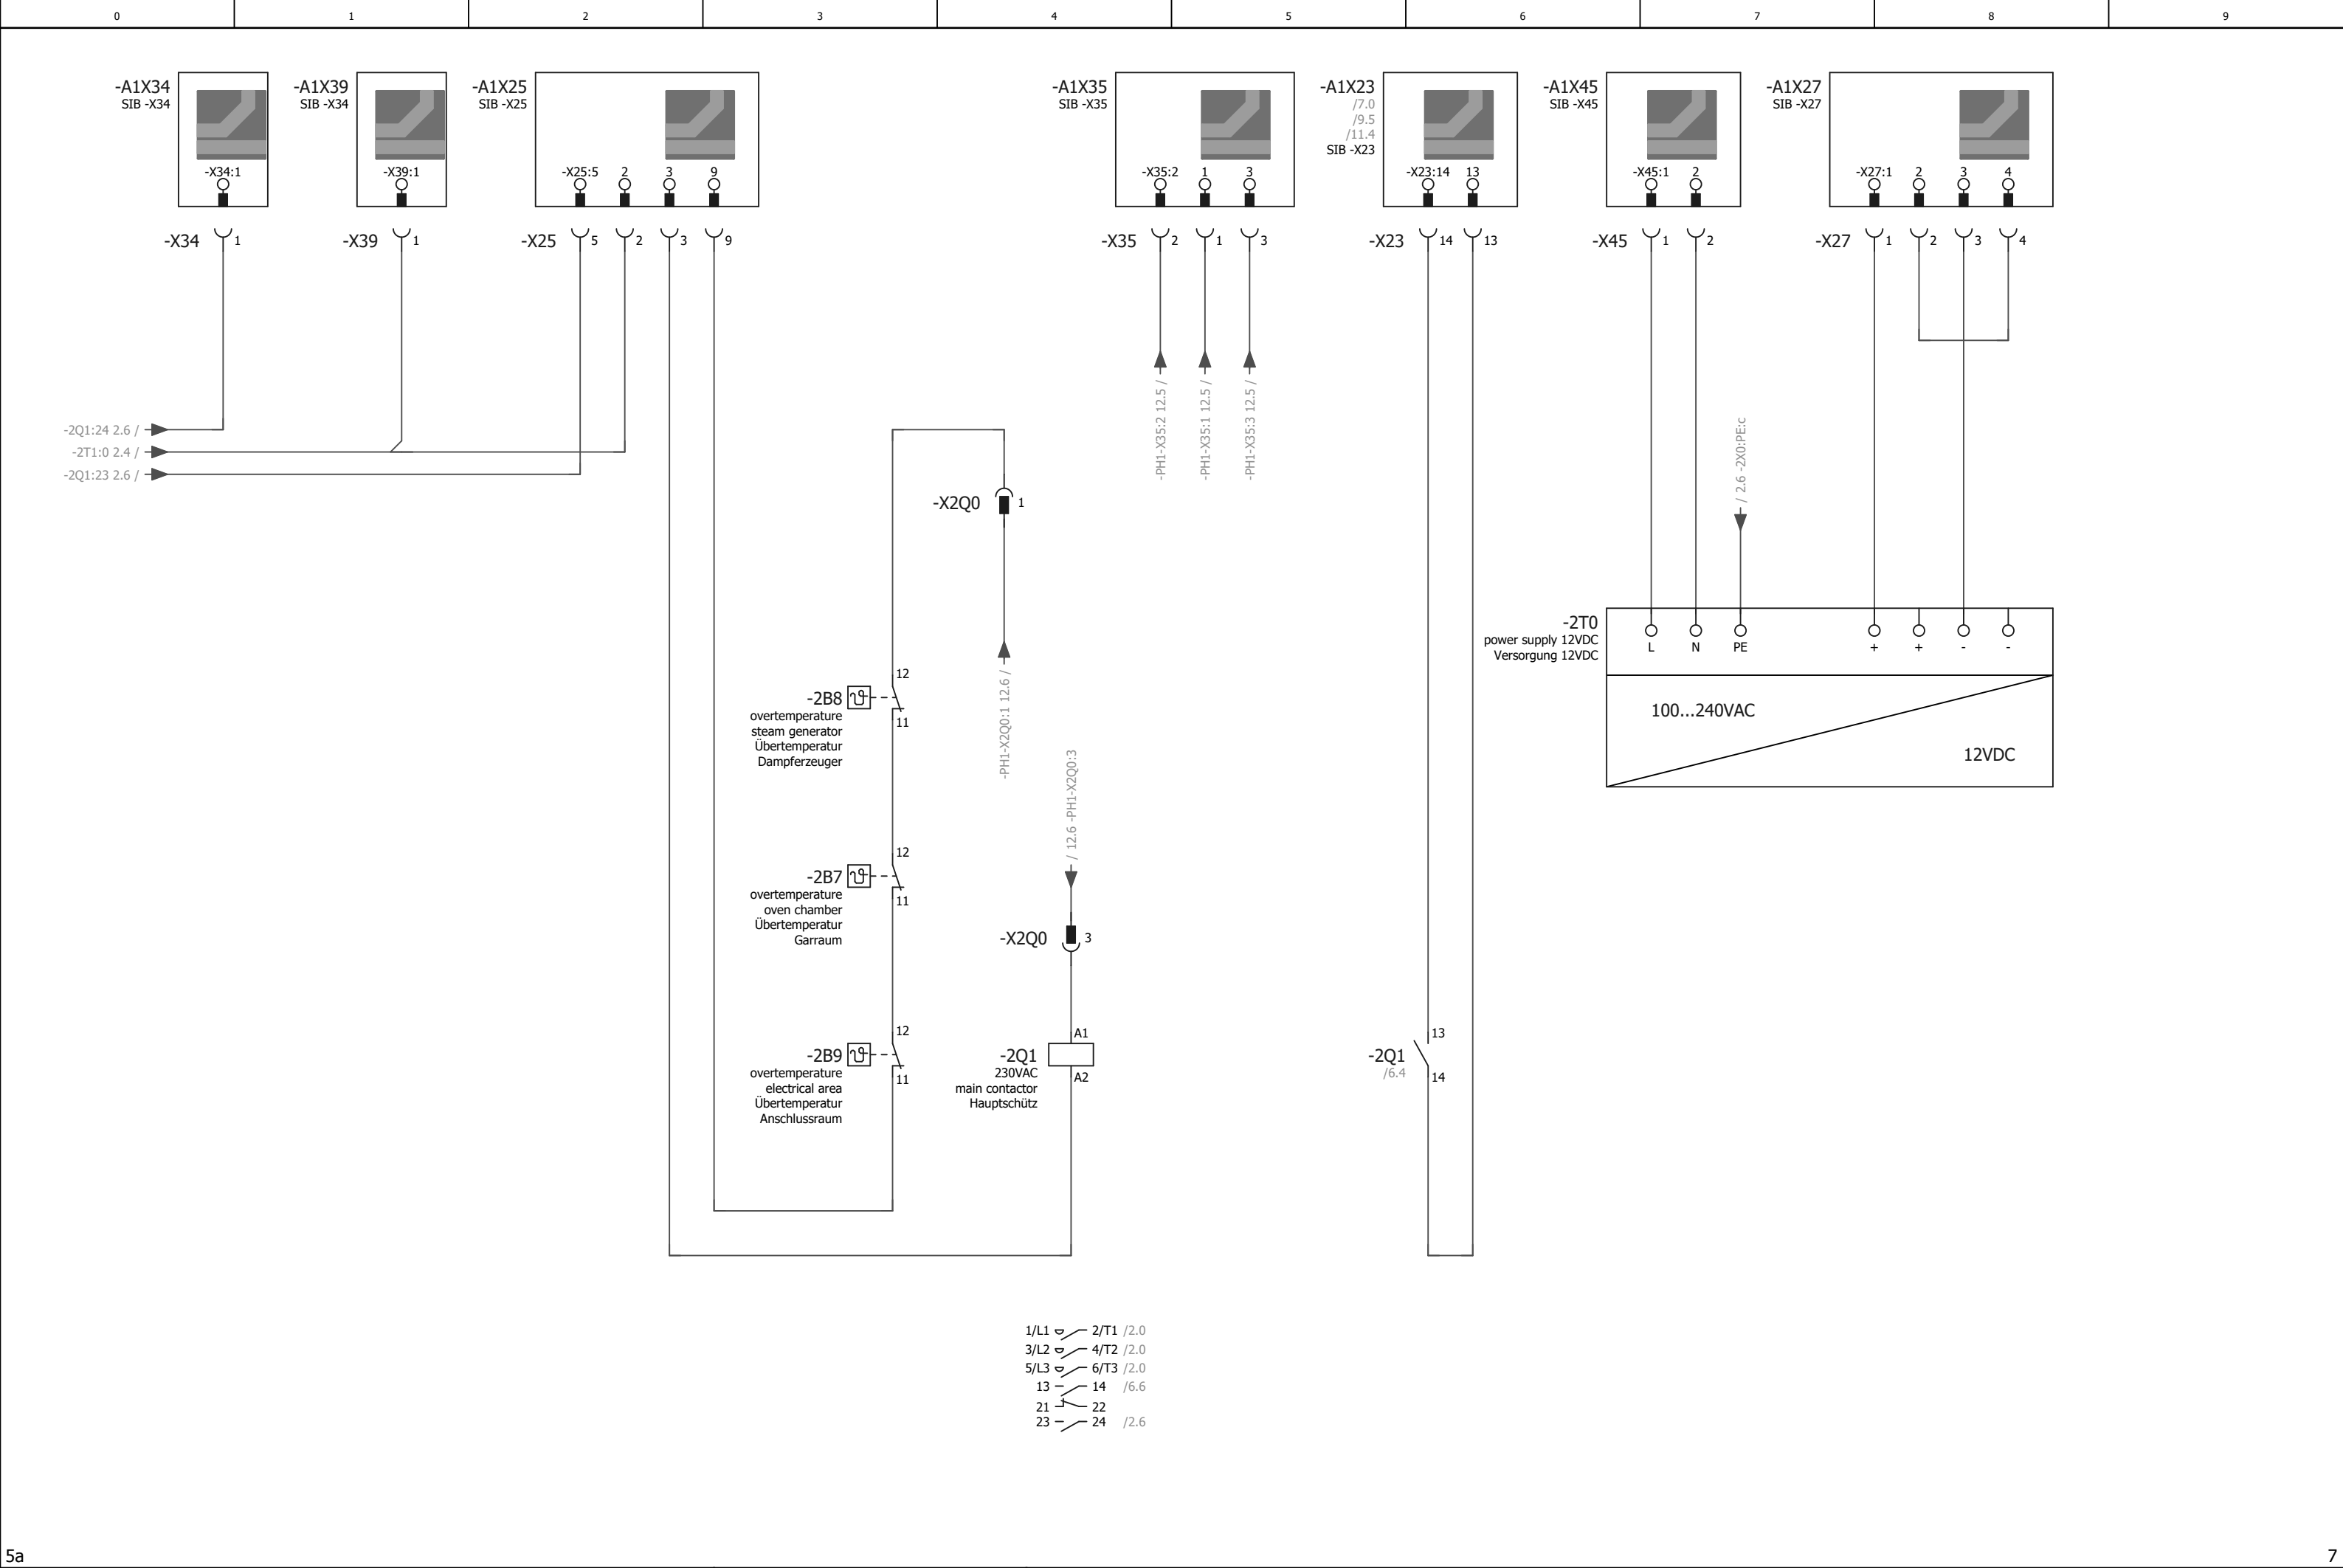

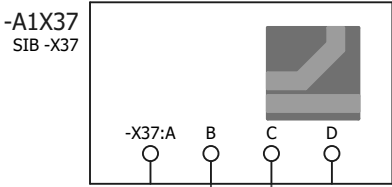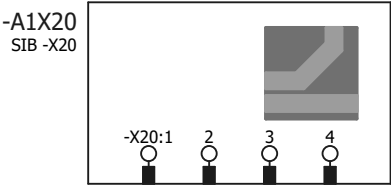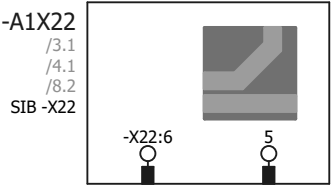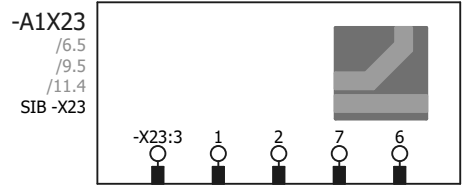

SICOTRONIC

