

electrical documentation



| type | rated voltage | frequency | rated power | rated current |
|--------------|---------------|-----------|-------------|---------------|
| C4e 20.20 EB | 440V 3PH | 60Hz | 56,3kW | |
| C4e 20.20 EB | 480V 3PH | 60Hz | 66,8kW | |
| | | | | |

Welbilt Deutschland GmbH


Talstraße 35
D-82436 Eglfing / Germany


+49 (0)8847 - 67 - 0

+49 (0)8847 - 67 - 414


www.convotherm.com


fuses on site!
Please look at local supply regulations!

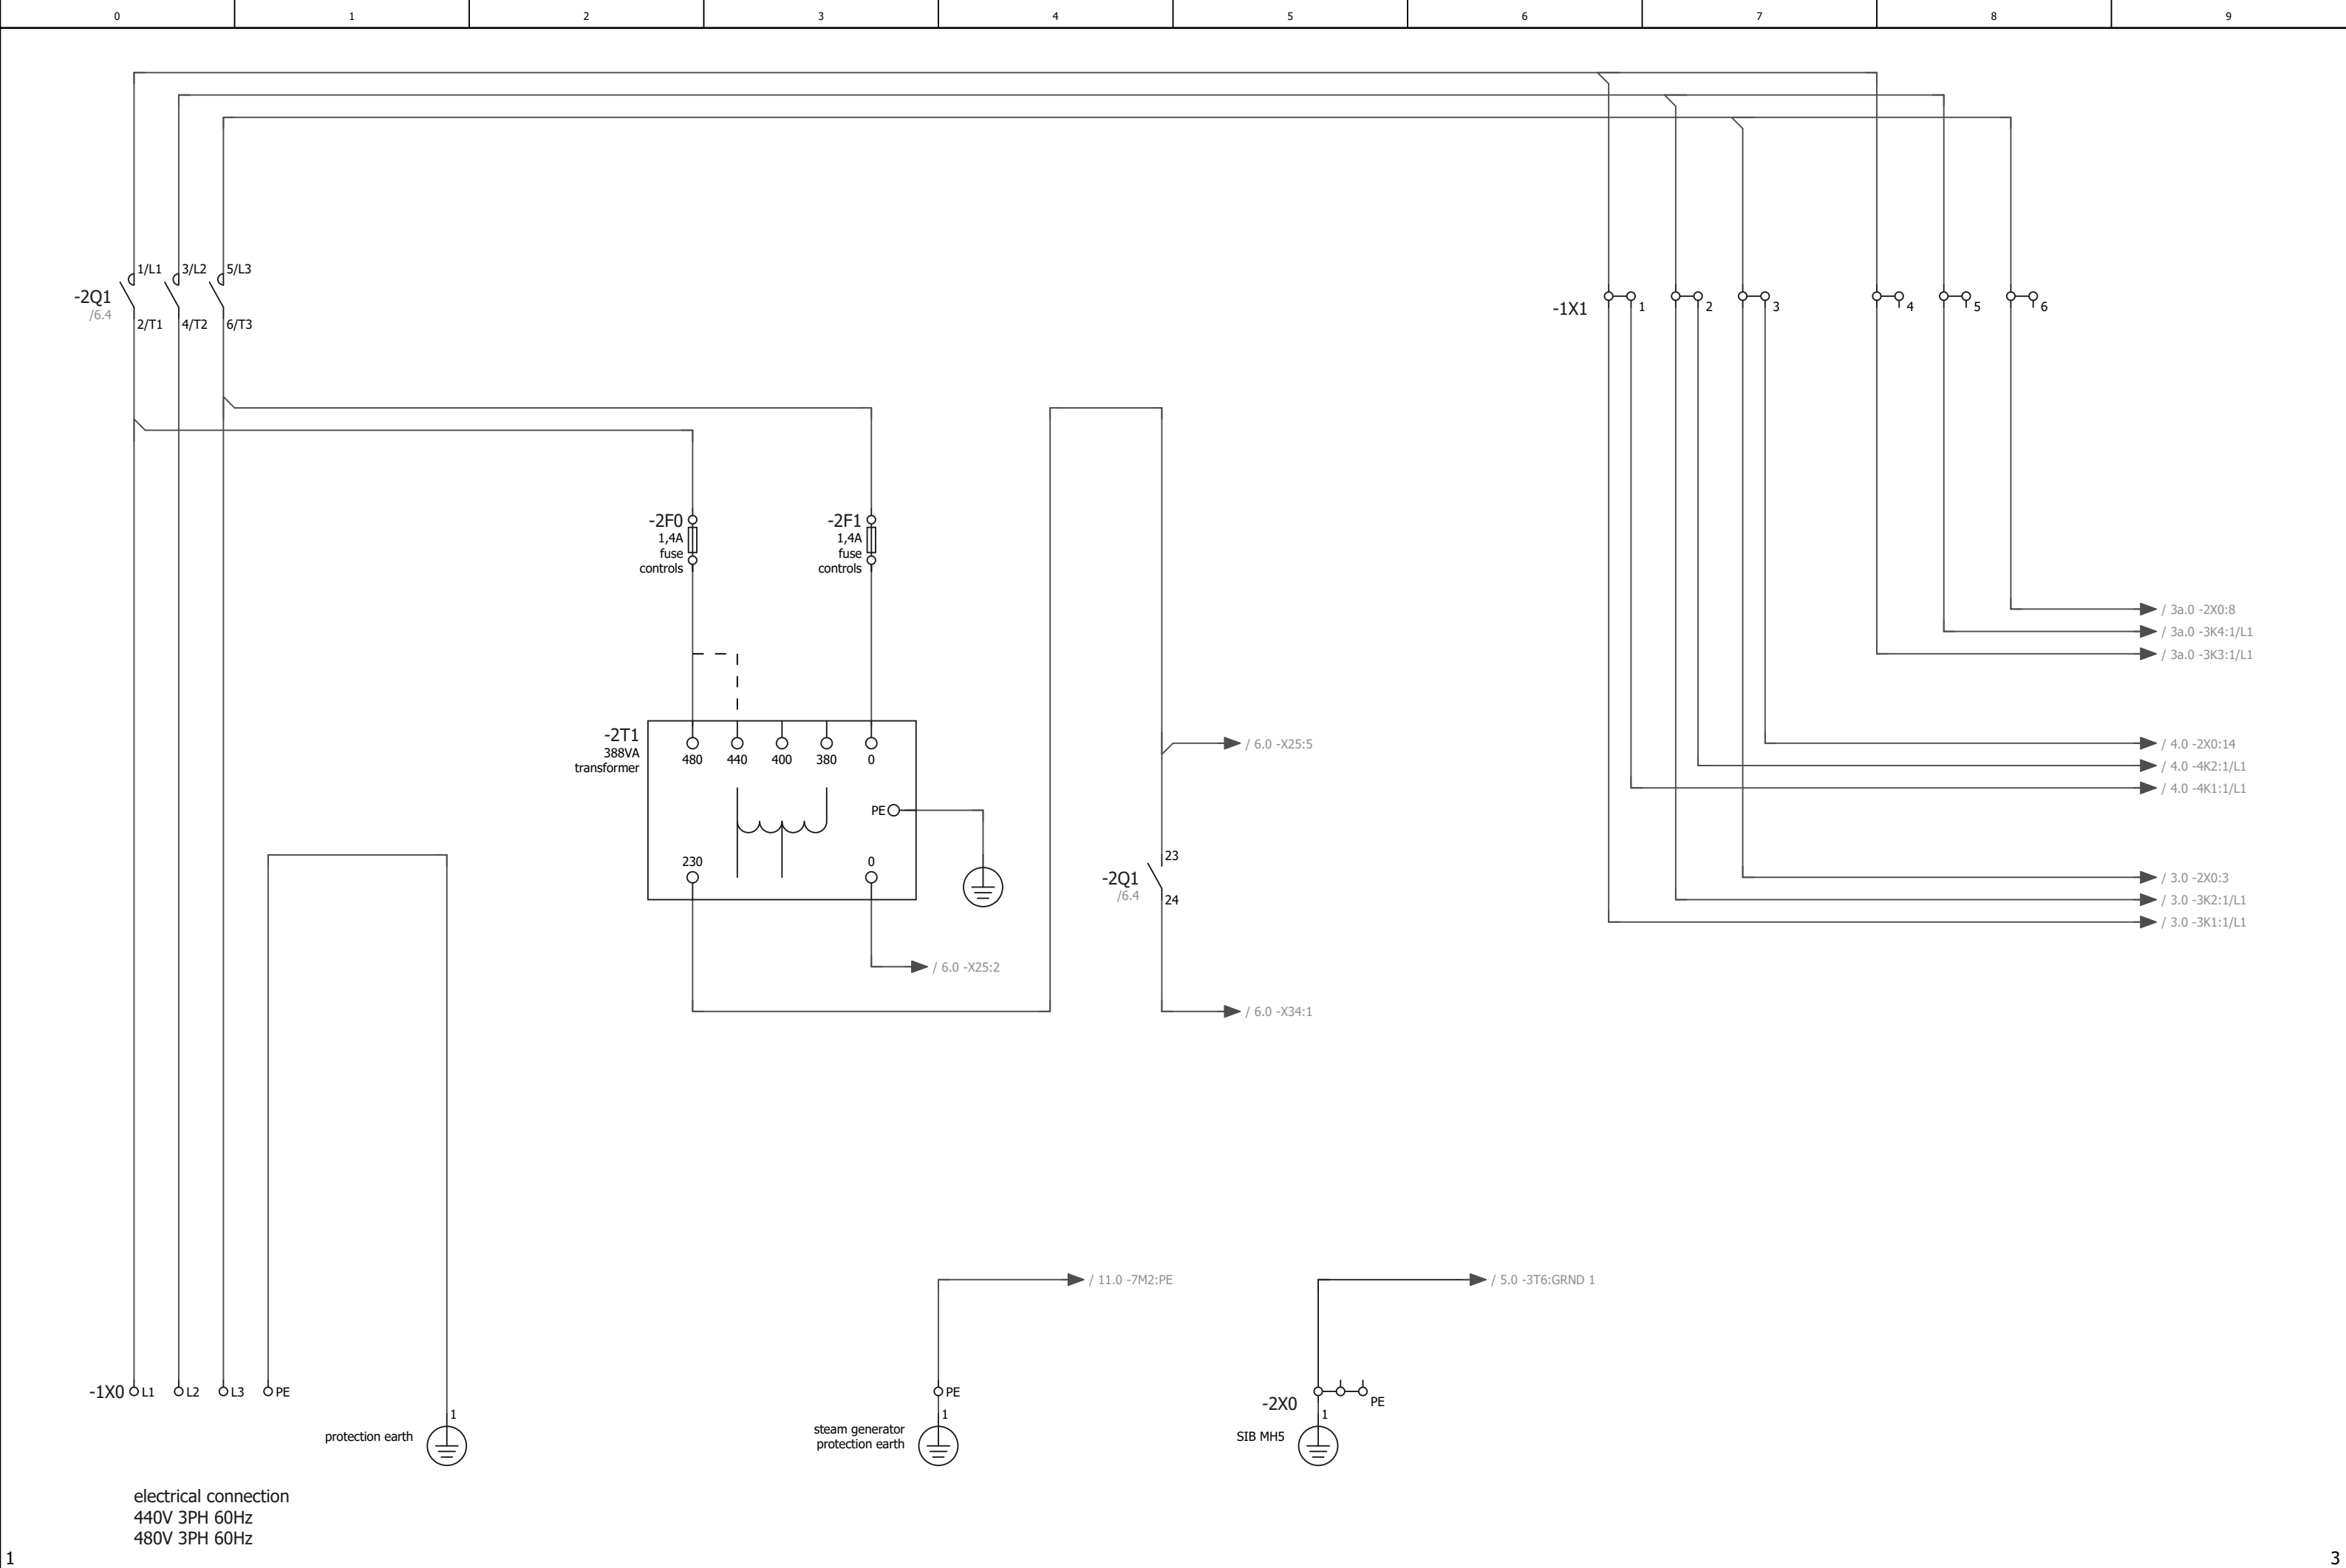

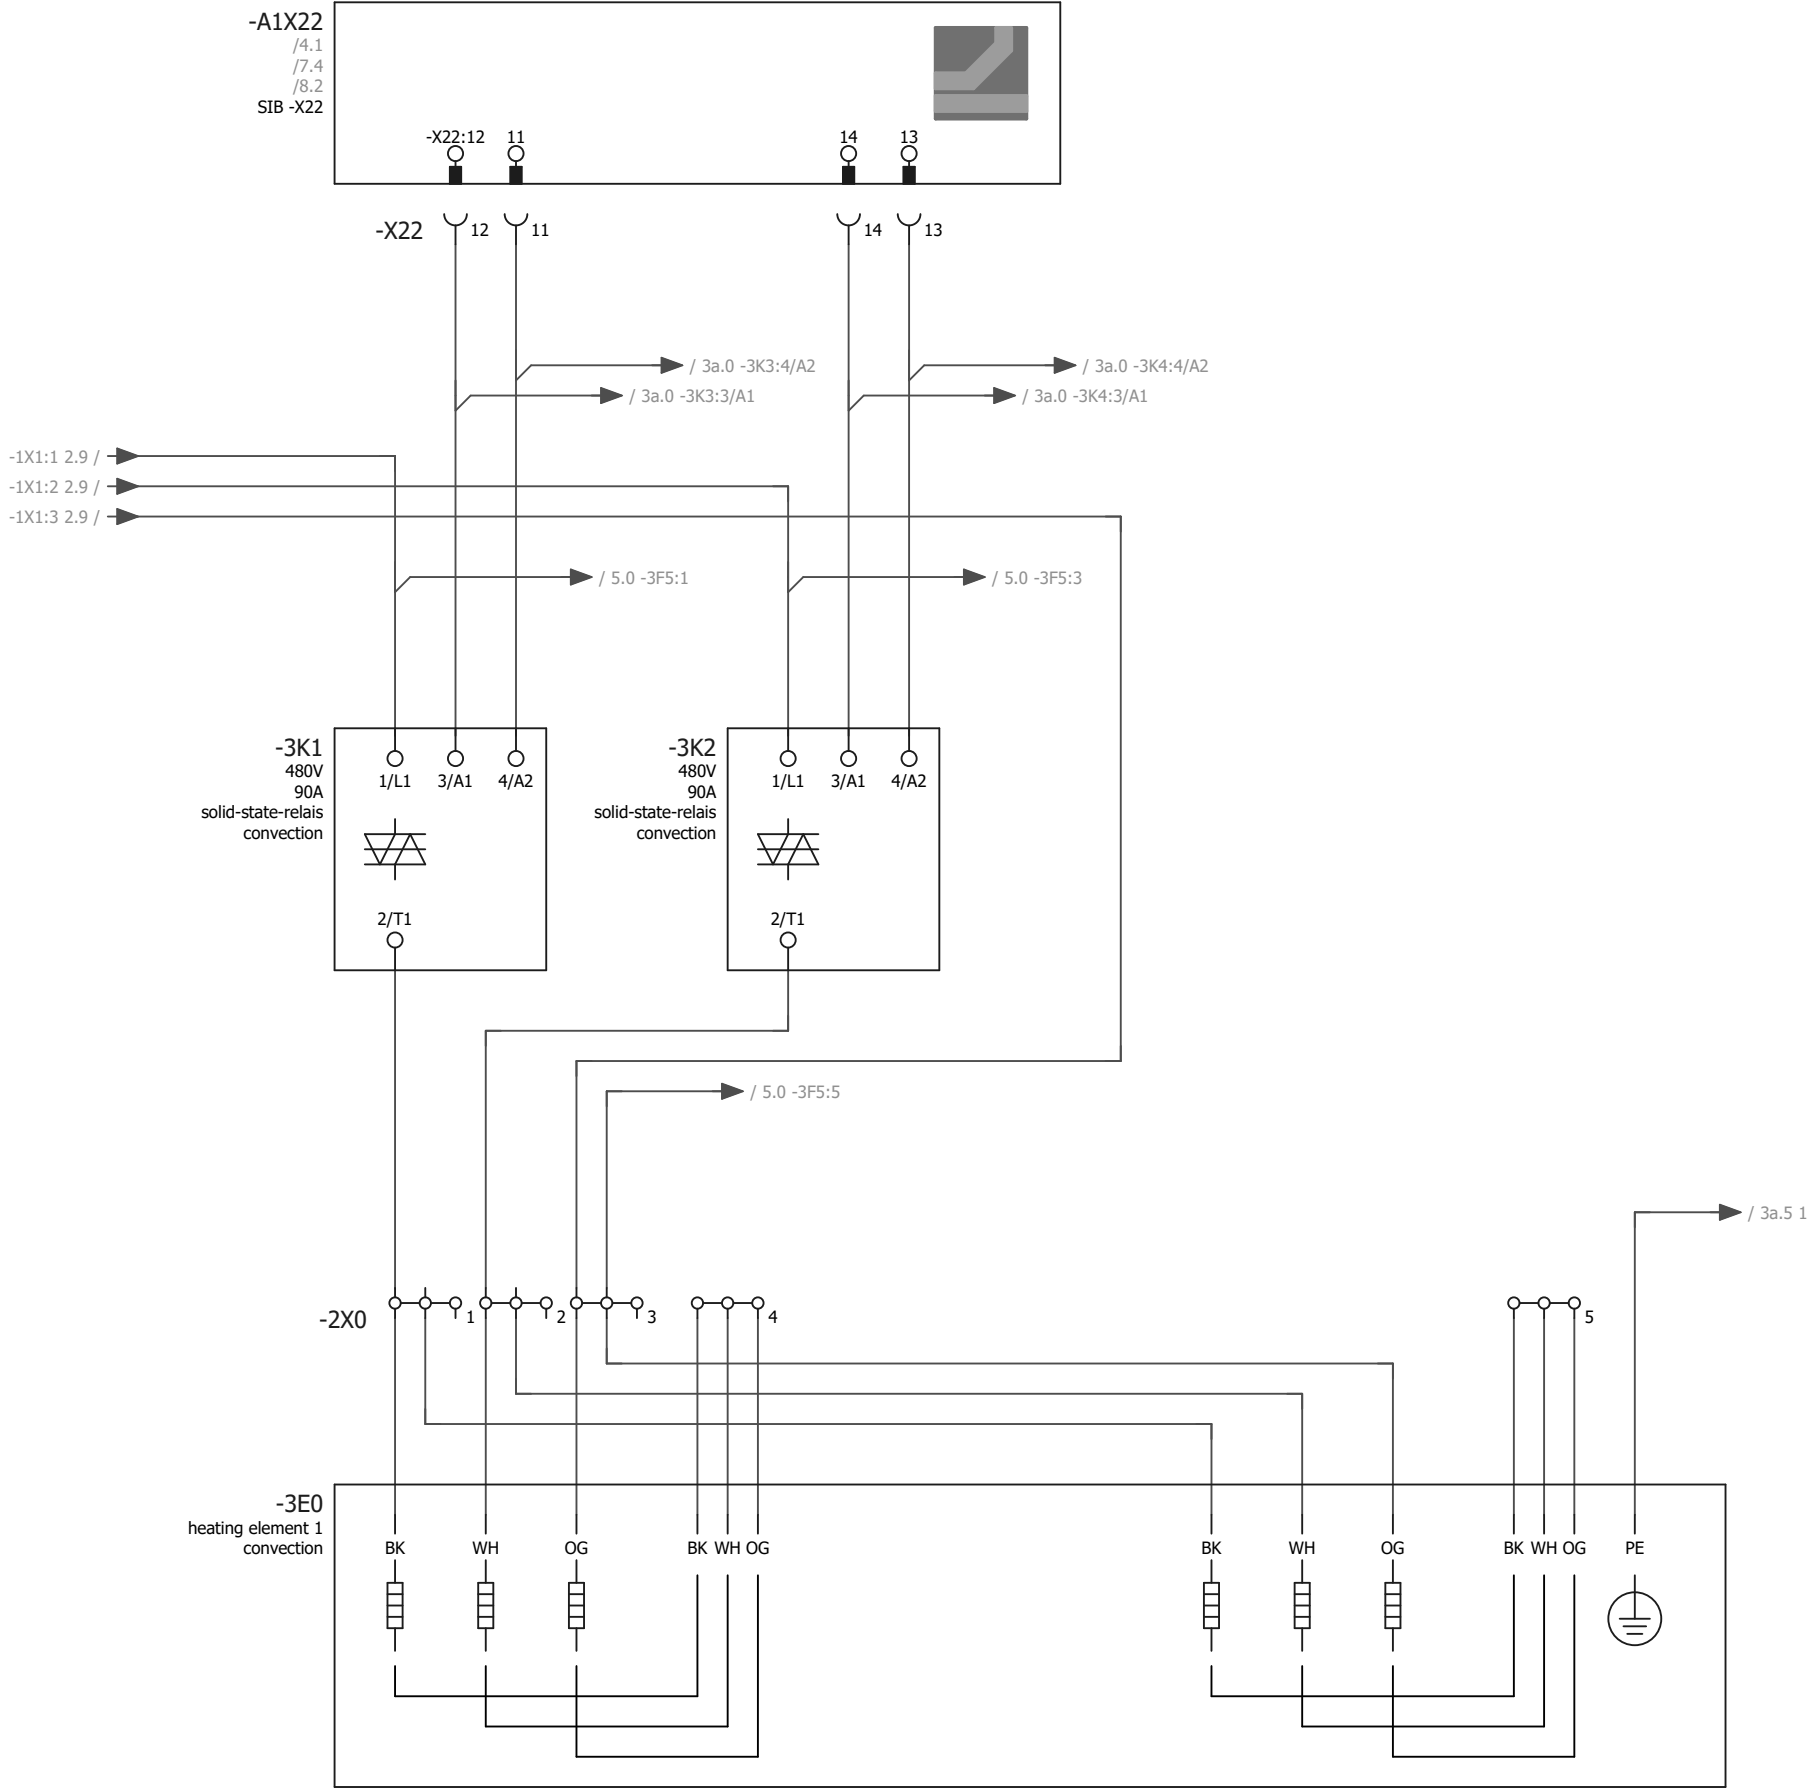

| | | | | | | | | | | | | |
|-----|------------|------------|------|-------|-----------|------------------------------|--|------------|------------------------|--|--------------|--|
| 04 | ÄM217/2015 | 22.12.2015 | SchM | Drawn | 4/21/2022 | C4e 20.20 EB C4e 20.20 EB | Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014 | convection | Project No. 5354132 | | = SLP | |
| 03 | ÄM145/2015 | 10.09.2015 | SchM | Name | Boe | | | | 5354132 | | + MPL | |
| 02 | ÄM071/2015 | 21.04.2015 | SchM | App. | SchM | | | | Drg. No. 5153076 | | Blatt 3a | |
| REV | Remarks | Date | Name | Norm | | | | | | | Seite 4 / 14 | |

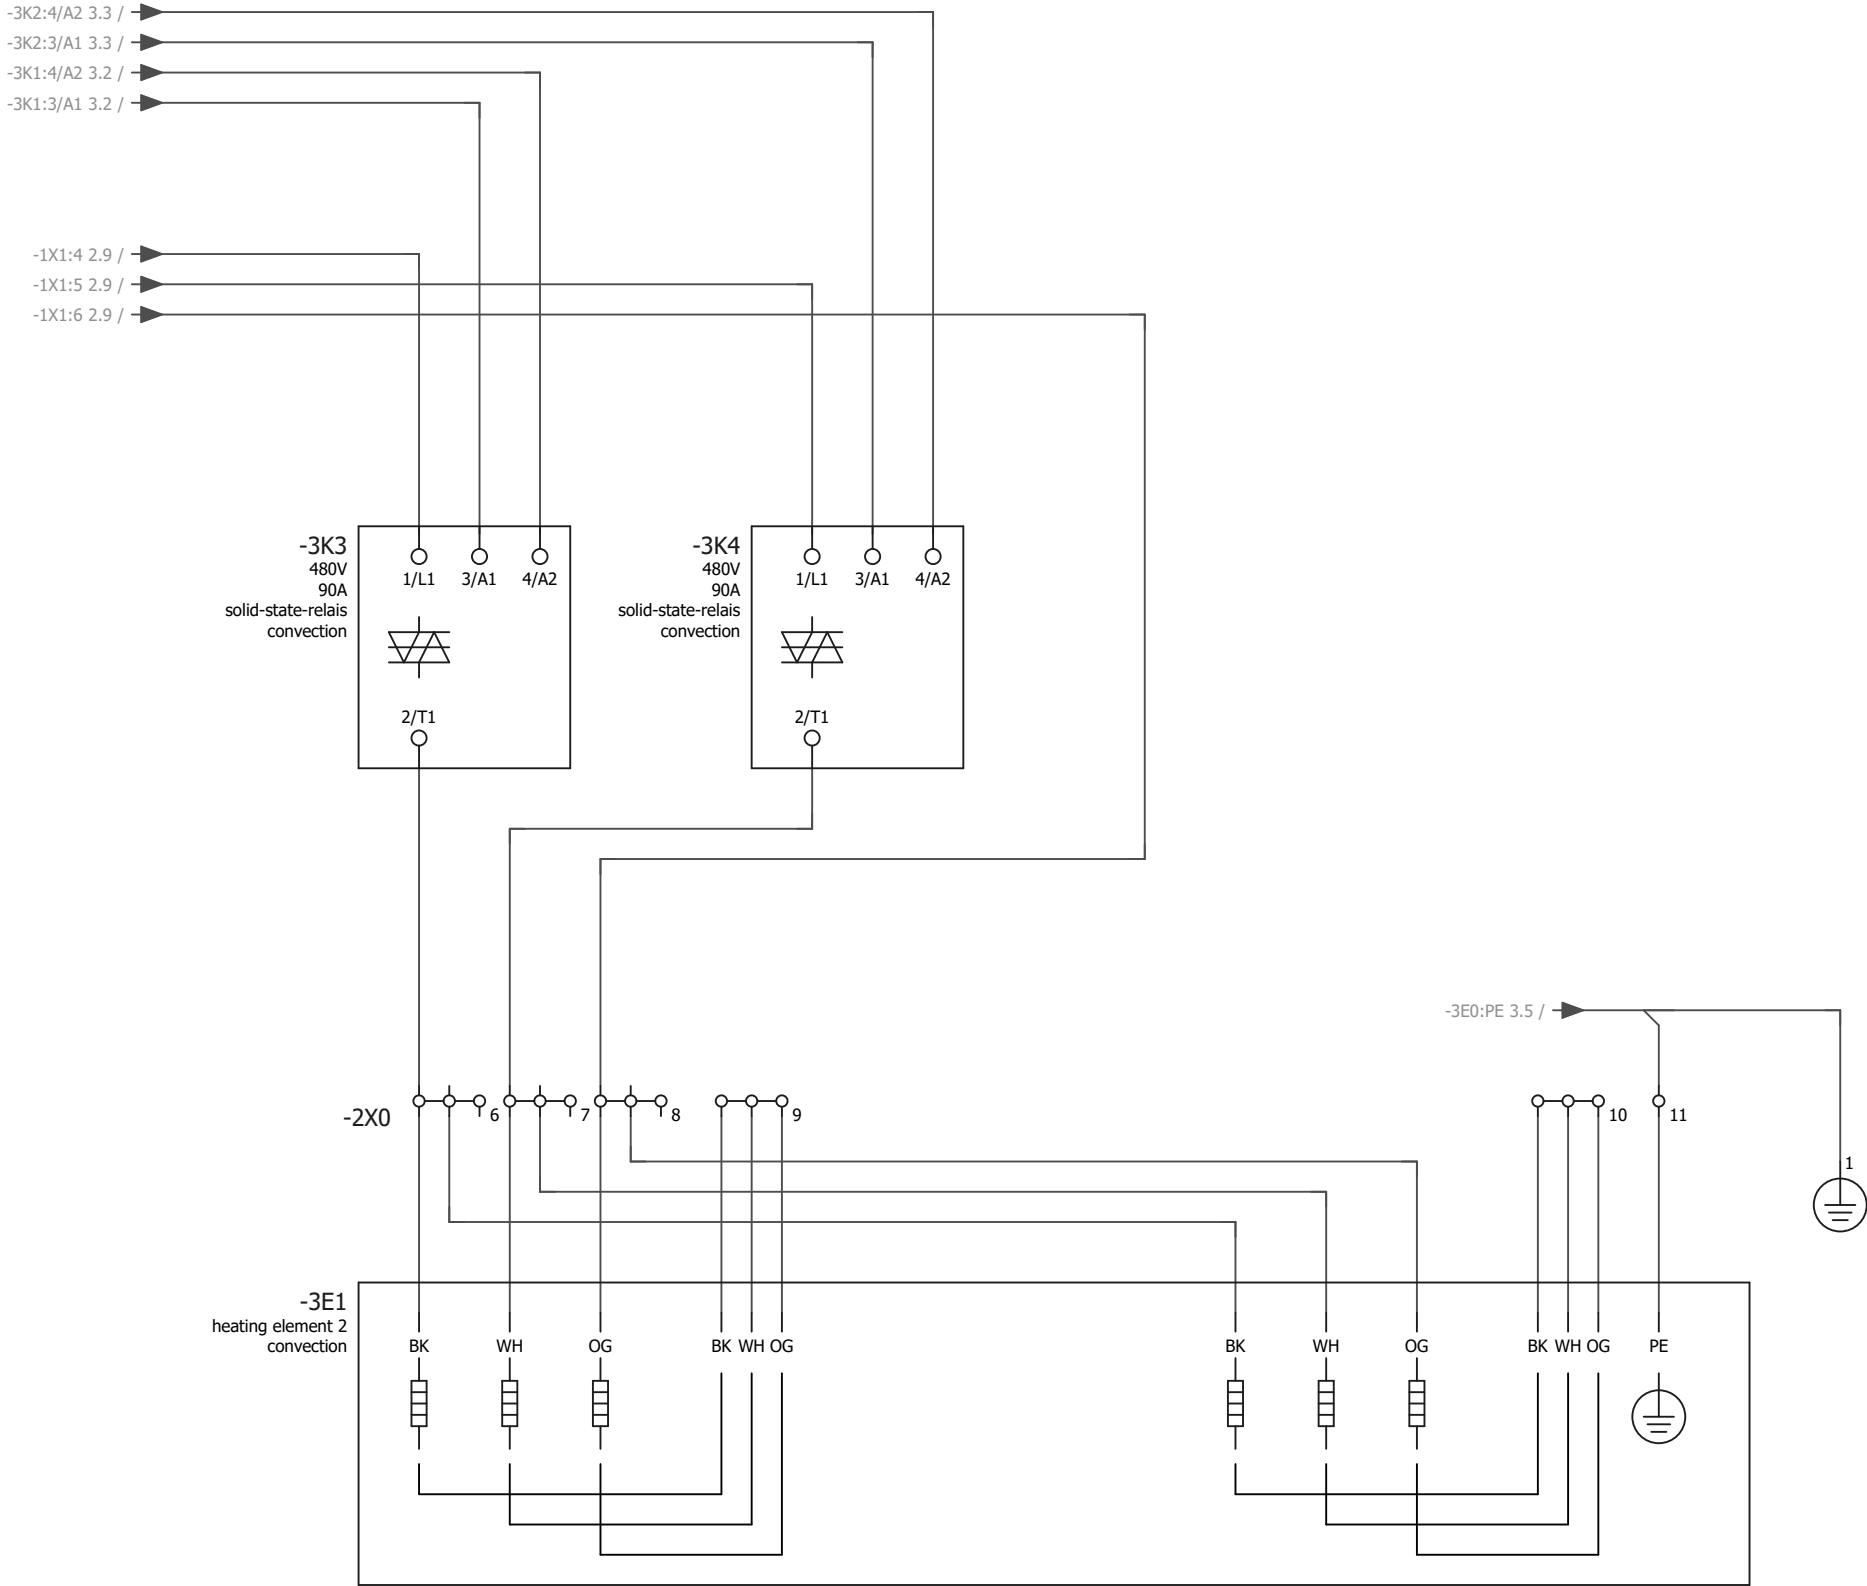

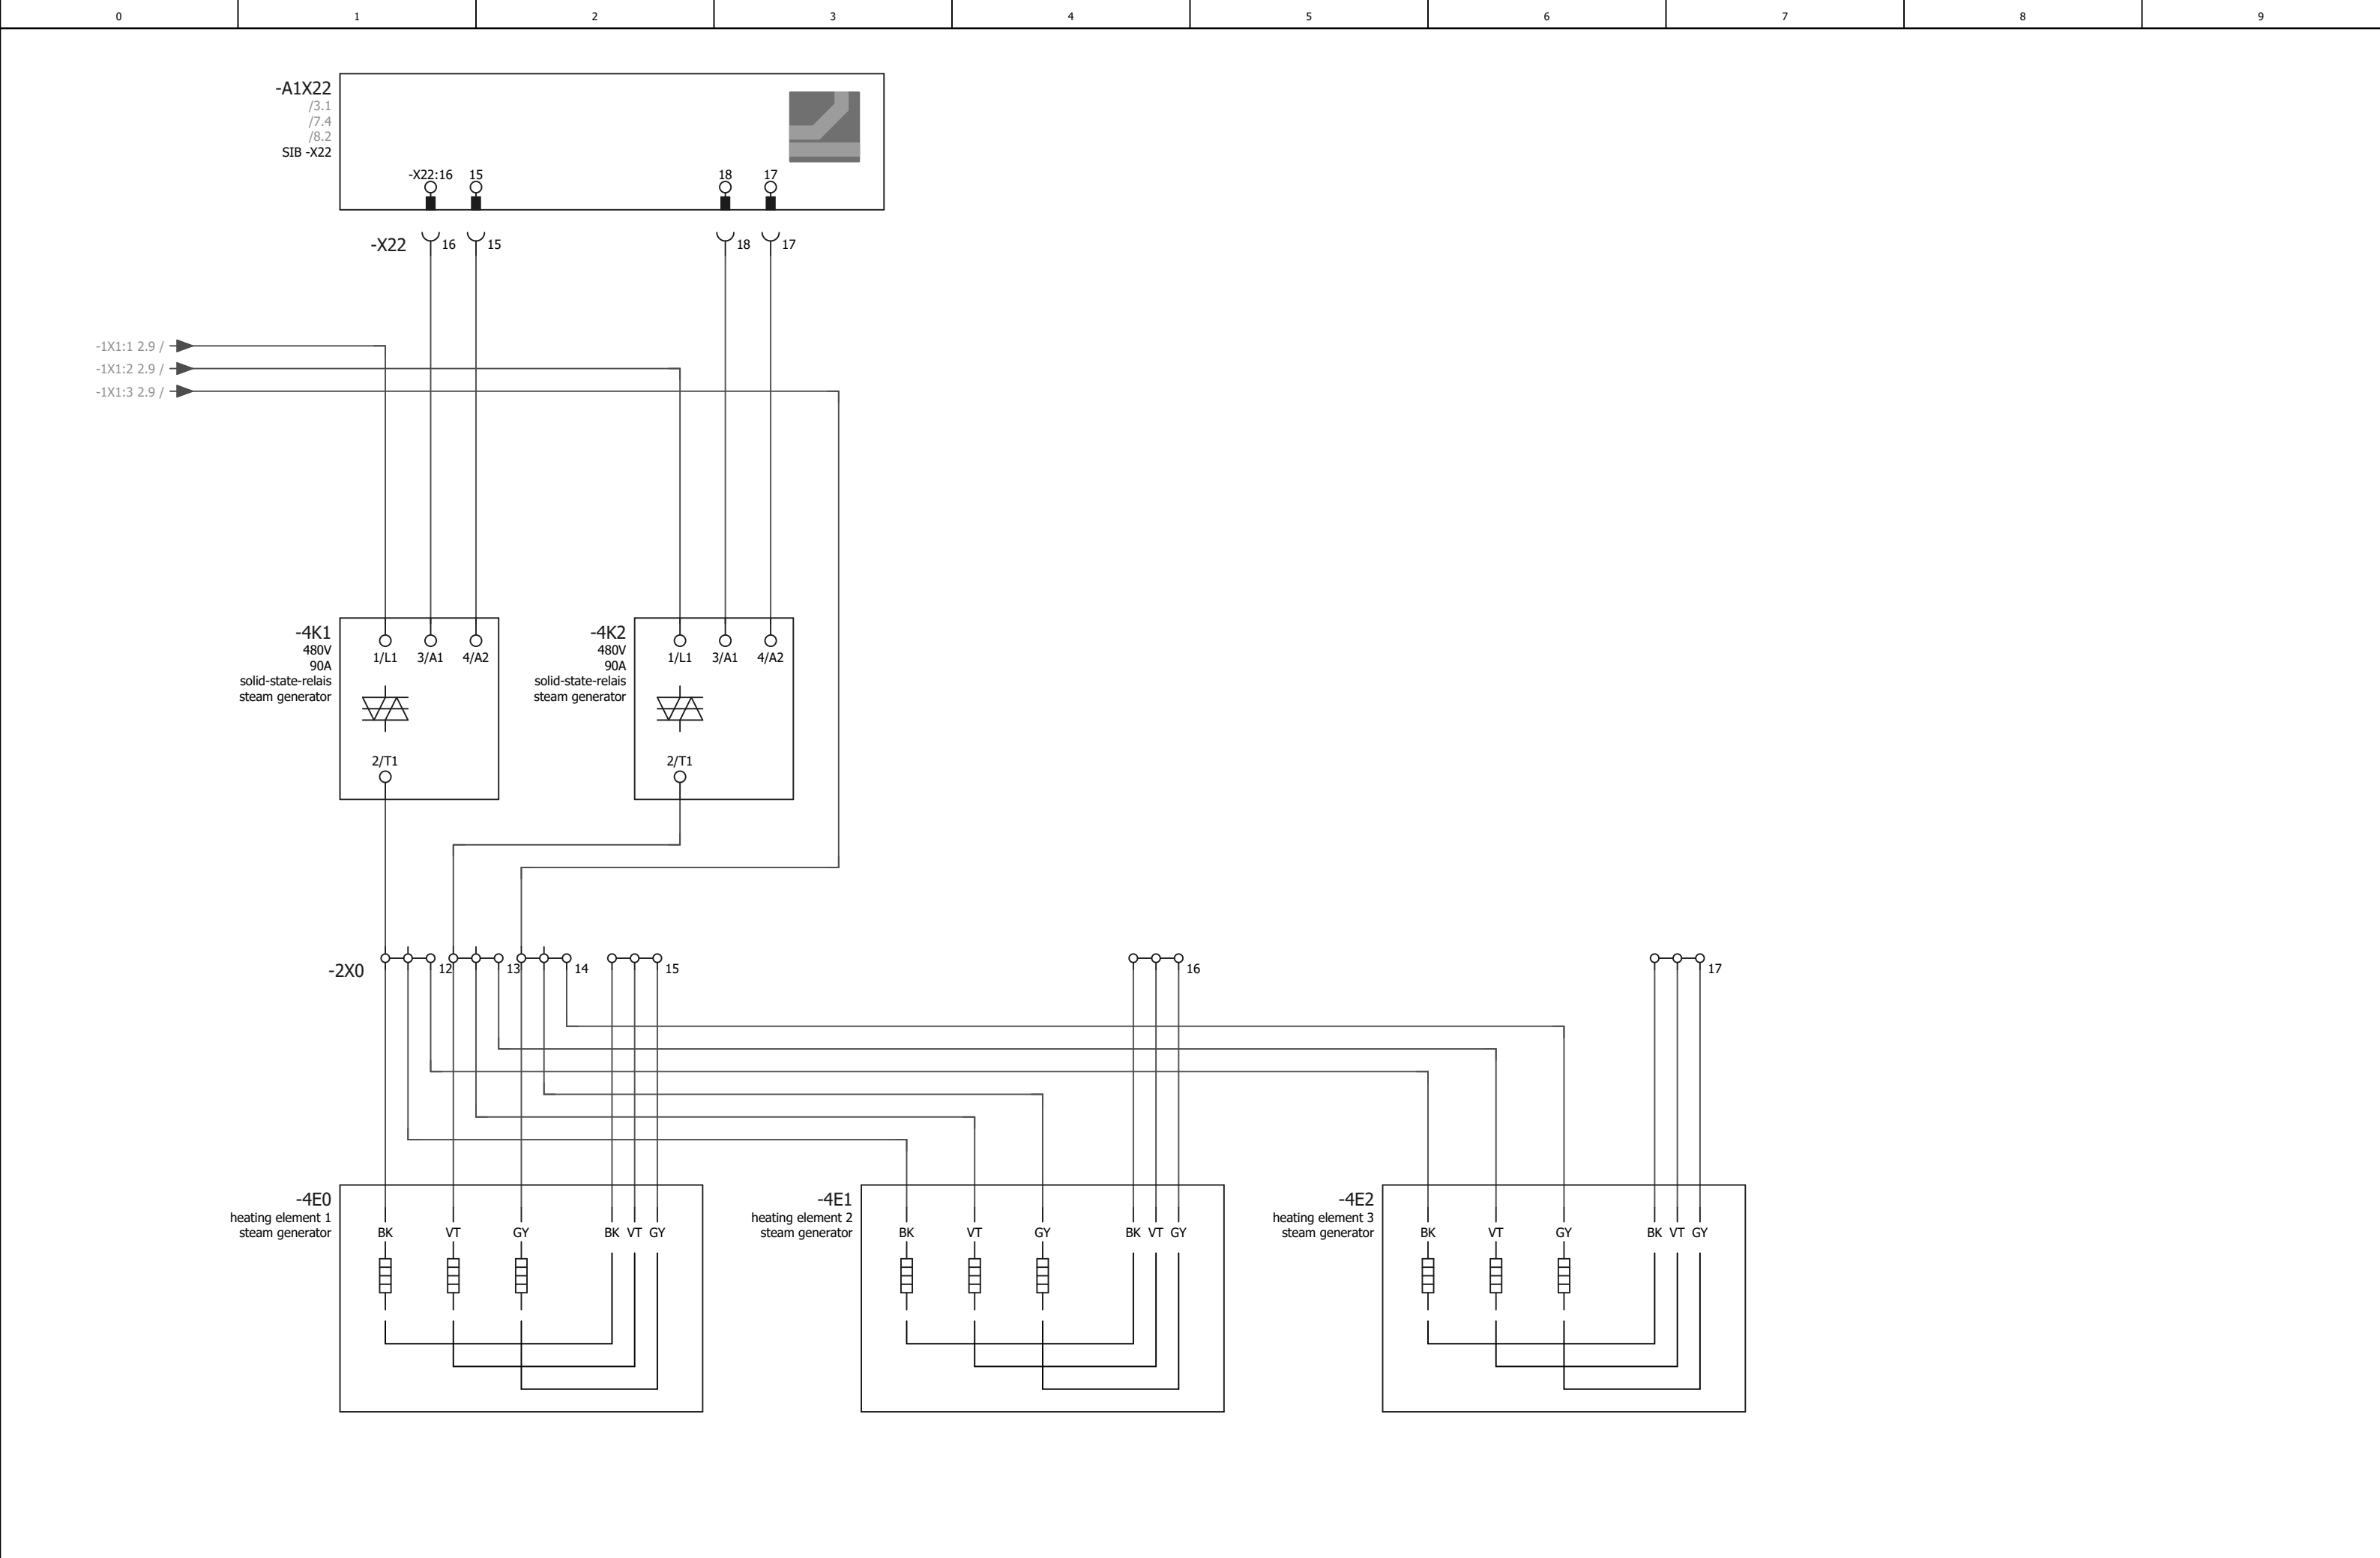

| | | | | | | | | | | | |
|-----|------------|------------|------|-------|-----------|------------------------------|--|-------|-------------|-------|--------------|
| 04 | ÄM217/2015 | 22.12.2015 | SchM | Drawn | 4/21/2022 | C4e 20.20 EB C4e 20.20 EB | Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014 | motor | Project No. | = SLP | |
| 03 | ÄM145/2015 | 10.09.2015 | SchM | Name | Boe | | | | 5354132 | + MPL | |
| 02 | ÄM071/2015 | 21.04.2015 | SchM | App. | SchM | | | | Drg. No. | | Blatt 5a |
| REV | Remarks | Date | Name | Norm | | | | | 5153076 | | Seite 7 / 14 |

